


Fig. 216

Heavy Pipe Clamp

Size Range: 3" through 42"
Material: Carbon steel
Finish: ☐ Plain or ☐ Galvanized
Service: Recommended for suspension of pipe lines where no insulation is required.
Maximum Temperature: Plain 750° F, Galvanized 450° F
Approvals: Complies with Federal Specification A-A-1192A (Type 4) WW-H-171-E (Type 4), ANSI/MSS SP-69 and MSS SP-58 (Type 4).
Installation: Normally used with welded eye rod or with weldless eye nut Fig. 290, see page 97.
Features:

- Designed for heavy load up to 750° F

Ordering: Specify pipe size, figure number, name and finish.
Note: If different loads or dimensions are required, refer to Fig. 42 SD non-standard two bolt pipe clamp.

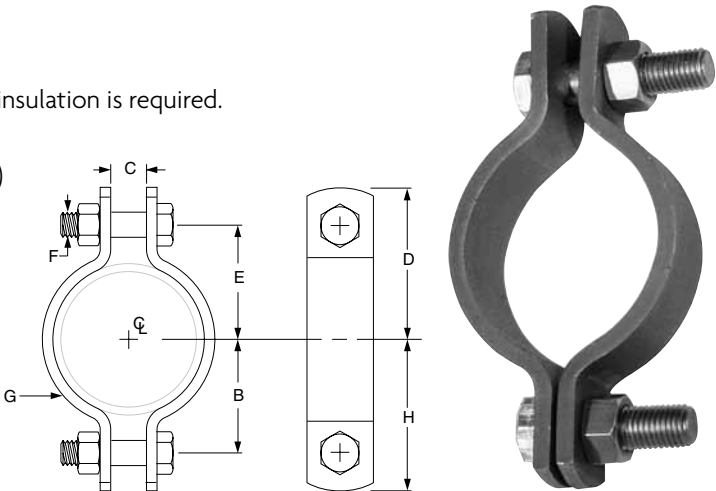

Note: This picture is representative of a typical Figure 216. Distance between clamp ears beneath pipe may or may not be equal to upper gap.

FIG. 216: LOADS (LBS) • WEIGHT (LBS) • DIMENSIONS (IN)										
Pipe Size	Max Load For Service Temp		Weight	B	C	D	Rod Take Out E	F	G Width	H
	650° F	750° F								
3	3,370	3,005	3.6	2 ¹⁵ / ₁₆	1	4	3 ¹ / ₈	¾	2	3 ¹³ / ₁₆
4	3,515	3,135	5.5	3 ⁹ / ₁₆		4 ⁷ / ₈	3 ³ / ₄	7 ⁷ / ₈		4 ¹ / ₁₆
5			6.3	4 ¹ / ₈		5 ¹ / ₂	4 ³ / ₈			
6	4,865	4,350	11.7	5	1 ¹ / ₈	6 ⁵ / ₈	5 ¹ / ₄	1	2 ¹ / ₂	6 ³ / ₈
8		4,340	13.9	6 ¹ / ₈		7 ⁵ / ₈	6 ¹ / ₄			7 ¹ / ₂
10	6,010	5,360	22.3	7 ⁹ / ₁₆	1 ¹ / ₄	9 ¹ / ₁₆	7 ¹¹ / ₁₆	1 ¹ / ₄		8 ¹⁵ / ₁₆
12	8,675	7,740	38.1	9	1 ⁵ / ₈	10 ⁷ / ₈	9 ¹ / ₄	1 ¹ / ₂	3	10 ⁵ / ₈
14	9,120	8,135	46.8	9 ³ / ₄		11 ⁷ / ₈	10		3 ¹ / ₂	11 ⁵ / ₈
16			51.4	10 ³ / ₄		12 ⁷ / ₈	11			12 ⁵ / ₈
18	13,800	—	130.1	14 ¹ / ₂	3	17 ¹ / ₄	14 ¹ / ₂	2	6	17 ¹ / ₄
20	15,300	—	163.6	16		18 ³ / ₄	16		5	18 ³ / ₄
24	16,300	—	215.2	18 ¹ / ₂	3 ¹ / ₄	21 ¹ / ₂	18 ¹ / ₂	2 ¹ / ₄	6	21 ¹ / ₂
28	18,000	—	302.8	20 ¹ / ₂		23 ¹ / ₂	20 ¹ / ₂		8	23 ¹ / ₂
30	20,500	—	365.4	22 ¹ / ₂	3 ¹ / ₂	26	22 ¹ / ₂	2 ¹ / ₂	7	26
32	23,750	—	431.7	23 ¹ / ₂		27	23 ¹ / ₂		8	27
34	25,000	—	533.8	25		28 ¹ / ₂	25			28 ¹ / ₂
36	28,000	—	575.1	26 ¹ / ₂		30 ¹ / ₄	26 ¹ / ₂	2 ³ / ₄	10	30 ¹ / ₄
42	35,000	—	915.7	30		33 ³ / ₄	30			33 ³ / ₄

PROJECT INFORMATION		APPROVAL STAMP	
Project:		<input type="checkbox"/> Approved	
Address:		<input type="checkbox"/> Approved as noted	
Contractor:		<input type="checkbox"/> Not approved	
Engineer:		Remarks:	
Submittal Date:			
Notes 1:			
Notes 2:			