

FIG. 7060S*

Standard Tee for Fire Protection

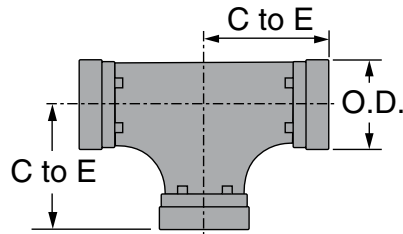


FIGURE 7060S* STANDARD TEE

Nominal Size	O.D.	Max. Rated Pressure	Center to End	Approx. Wt. Ea.
In./DN(mm)	In./mm	PSI/bar	In./mm	Lbs./Kg
1	1.315	300	2 1/4	0.9
25	33.4	20.7	57	0.4
1 1/4	1.660	300	2 3/4	1.5
32	42.2	20.7	70	0.7
1 1/2	1.900	300	2 3/4	1.8
40	48.3	20.7	70	0.8
2	2.375	300	3 1/4	2.4
50	60.3	20.7	83	1.1
2 1/2	2.875	300	3 3/4	4.0
65	73.0	20.7	95	1.8
3 O.D.	2.996	300	4	4.6
76.1	76.1	20.7	101	2.1
3	3.500	300	4 1/4	5.8
80	88.9	20.7	108	2.6
4	4.500	300	5	10.3
100	114.3	20.7	127	4.7
5 1/2 O.D.	5.500	300	5 1/2	16.1
139.7	139.7	20.7	140	7.3
5	5.563	300	5 1/2	16.2
125	141.3	20.7	140	7.3
6 1/2 O.D.	6.500	300	6 1/2	24.4
165.1	165.1	20.7	165	11.1
6	6.625	300	6 1/2	25.7
150	168.3	20.7	165	11.7
8	8.625	300	7 3/4	41.1
200	219.1	20.7	197	18.6
10	10.750	300	9	74.5
250	273.1	20.7	229	33.8
12	12.750	300	10	94.7
300	323.9	20.7	254	43.0

Additional sizes available, see Gruvlok Catalog or contact an Anvil Representative.

These fittings are designed to provide minimal pressure drop and uniform strength.



For Listings/Approval Details and Limitations, visit our website at www.anvilintl.com or contact an Anvil® Sales Representative.

 - Available galvanized.

* When ordering, refer to product as FP7060S.

MATERIAL SPECIFICATIONS

CAST FITTINGS:

Ductile Iron conforming to ASTM A-536

COATINGS:

- ☐ Rust inhibiting paint Color: ORANGE (standard) or
- ☐ Hot Dipped Zinc Galvanized conforming to ASTM A-153 (optional)
- ☐ Other available options: Example: RAL3000 or RAL9000 Series

PROJECT INFORMATION

APPROVAL STAMP

Project:	<input type="checkbox"/> Approved
Address:	<input type="checkbox"/> Approved as noted
Contractor:	<input type="checkbox"/> Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	