## **GUIDES & SLIDES**



## □ Fig. 439: Structural "H" Slide Assembly □ Fig. 439A: Structural "H"

### Pipe Slide Assembly, Complete

#### Size Range: 6" through 36"

Material: Carbon steel "H" section, PTFE bonded slide plates and carbon steel base. Finish: Plain, Painted or Hot-Dip Galvanized (Welded after Galvanizing and Cold Spray Touched-up) Service: A heavy duty slide support where horizontal movement resulting from expansion and contraction takes place and where a low coefficient

of friction is desired. **Approvals:** Complies with Federal Specification A-A-1192A (Type 35), ANSI/MSS SP-69 and MSS SP-58 (Type 35).

**Maximum Load:** As indicated at 70° F see page 135 for rating factor at higher temperatures.

#### Maximum Temperature: 750° F

Temperature Range at PTFE: -20° F to 400° F Features:


- No lubrication required.
- Allows up to 4" of insulation.
- Allows up to 10" travel standard.
- Weld in place design.

#### Available Options:

- Increased travels.
- Increased "H" Section heights.
- Clamps, Fig. 212 or Fig. 432.
- Base plate with mounting holes. The bolt spacing for the bolted base plates is equal to the "W" dimention minus  $1^{1}/_{2}$ " and the "BL" dimention minus  $1^{1}/_{2}$ " for all pipe sizes and the hole diameter is  $^{9}/_{16}$ " for all sizes.

**Ordering:** Specify figure number, type, name, finish and any other option desired.

**Notes:** Types 1, 2, and 3 provide for longitudinal movement only. Types 4 and 5 provide for both longitudinal and transverse movement of piping.

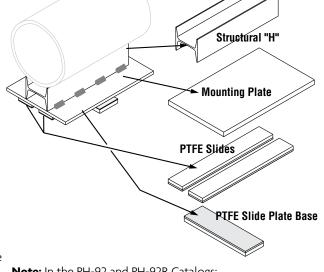

PTFE Pipe Slide Assembly - "H" Type

**Note:** In the PH-92 and PH-92R Catalogs:

The Fig. 439 (slide "H" section only) formerly referred to as Fig. 437. The Fig. 439 (slide base plate) formerly referred to as Fig. 438 (slide base plate).

The acceptability of galvanized coatings at temperatures above 450°F is at the discretion of the end user.




FIG. 439: DIMENSIONS (IN) • LOADS (LBS)										
	B Type			D * Type			Max Load			
Pipe Size							Dawa	Side	Up	
	1 & 4	2 & 5	3	1 & 4	2 & 5	3	Down	Type 2, 3, 5	Type 3	
6	5	5 <sup>1</sup> /4	<b>5</b> <sup>5</sup> ⁄16	<b>7</b> <sup>3</sup> ⁄4	8	8	12,000	3,000	1,200	
8	Э	<b>J</b> 74	<b>3</b> %16	<b>8</b> <sup>3</sup> ⁄4	9	9				
10	51⁄8	53%8	57⁄16	95/8	97/8	<b>9</b> <sup>15</sup> / <sub>16</sub>	16,000	4,000	1,600	
12				10¾	11	<b>11</b> <sup>1</sup> ⁄16				
14				107/8	11 <sup>1</sup> / <sub>8</sub>	<b>11</b> <sup>3</sup> ⁄16				
16				12 <sup>1</sup> / <sub>8</sub>	123/8	<b>12</b> <sup>7</sup> /16				
18				125/8	127/8	12 <sup>15</sup> /16				
20				13¾	14	14 <sup>1</sup> /16				
24	5 <sup>1</sup> /4	5½	<b>5</b> %16	15%	151/8	<b>15</b> <sup>15</sup> ⁄16	24,000	6,000	2,400	
30	6 <sup>1</sup> /4	65%	6 <sup>11</sup> /16	195%	19 <sup>7</sup> /8	<b>20</b> <sup>1</sup> / <sub>16</sub>				
36	<b>6</b> <sup>7</sup> / <sub>16</sub>	6 <sup>13</sup> /16	<b>6</b> <sup>3</sup> ⁄4	23	23 <sup>1</sup> / <sub>4</sub>	<b>23</b> <sup>7</sup> / <sub>16</sub>				

\* With clamps; add material thickness of a Fig. 212 for bolted bases add 5/16" to height "H" dimension.
\*\* With the Figure 432 special clamp, add the material thickness of Figure 432.

PROJECT INFORMATION	APPROVAL STAMP
Project:	Approved
Address:	Approved as noted
Contractor:	Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	
DU 1 15	



# Fig. 439

### Structural "H" Slide Assembly, Complete

