
SPECIFICATION SUBMITTAL SHEET

WATER-TITE
IPS CORPORATION

Shock-Buster™ Hammer Arresters

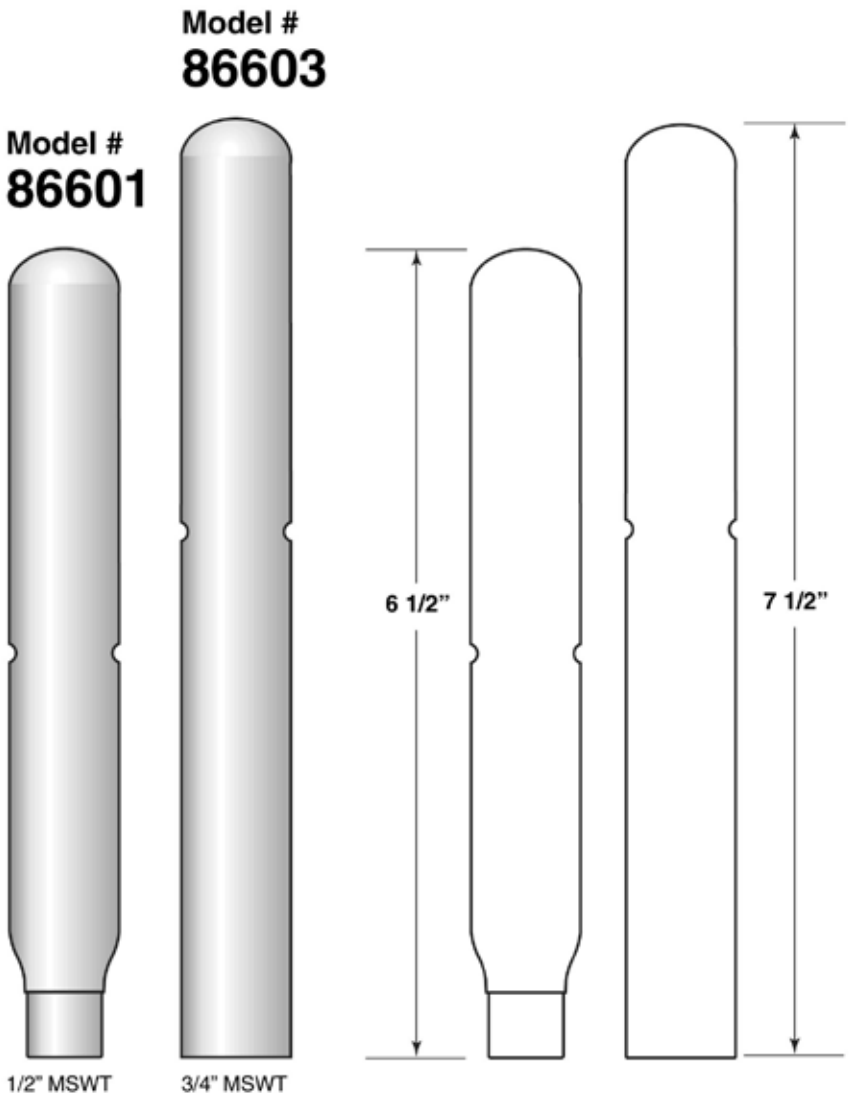

SPECIFICATIONS

IPS Water-Tite #86601 & #86603 "AA" size hammer arresters with double o-ring piston shall be installed on CTS female fitting. Unit shall be installed on single fixture. Hammer Arrester must be ANSI/ASSE 1010 certified.

Working Limits
Max working Temp: 250 F
Max working Press: 250 PSIG

UPC/ANSI/ASSE 1010-2004/
Complies with IPC 604.9

PROD. CODE
86601
86603

MODEL#	DESCRIPTION
86601	1/2" Male Sweat Hammer Arrester
86603	3/4" Male Sweat Hammer Arrester

IPS CORPORATION
500 Distribution Parkway, Collierville, TN 38017, USA ■ TEL: 800-888-8312 ■ Fax: 901-853-5008 ■ www.ipscorp.com