

175 PSI WWP Iron Body Gate Valves

Fire Protection Post Indicator Valve • Bolted Bonnet • Indicator Post Pattern
• Non-Rising Stem • Solid Wedge

175 PSI/12.1 Bar Non-Shock Cold Water

UL/ULC LISTED • FM APPROVED



MATERIAL LIST

PART	SPECIFICATION
1. Nut	Steel ASTM A307
2. Square Oper. Nut	Cast Iron ASTM A126 Class B
3. Stem	Brass ASTM B16 Alloy C36000
4. Ind. Post Flange Nut	Steel ASTM A307
5. Ind. Post Flange	Cast Iron ASTM A126 Class B
6. Ind. Post Flange Bolt	Steel ASTM A307
7. O-Ring Seal	Buna-N Rubber
8. Bonnet	Cast Iron ASTM A126 Class B
9. Ind. Post Flange Gasket	Aramid Fiber / Graphite
10. Body Bolt	Steel ASTM A307
11. Body Gasket	Aramid Fiber/Graphite
12. Body Nut	Steel ASTM A307
13. Body	Cast Iron ASTM A126 Class B
14. Wedge Bushing*	Cast Bronze B584 Alloy C84400
15. Wedge	Cast Iron ASTM A126 Class B
16. Wedge Face Ring	Cast Bronze B584 Alloy C84400
17. Seat Ring	Cast Bronze B584 Alloy C84400

NOTE: 1. Flanged valve is consistent with ANSI B16.1 Class 125.
2. Post Flange has a 12 OD and 10.5" bolt circle.
3. NIBCO may substitute Ductile Iron ASTM A395 (60-40-18) for ASTM A126 Class B Cast Iron for the Body, Bonnet, Wedge, or Disc. NIBCO may substitute Ductile Iron ASTM A395 (60-40-18) or ASTM A536 (65-45-12) for all other ASTM A126 Class B Cast Iron components.

* Compliance with the Standard for Gate Valves for Fire Protection Service, UL 262, and the Canadian Requirements, ULC/ORD-C262.

DIMENSIONS—WEIGHTS—QUANTITIES

F-609 Dimensions												Weight	
Size	A		B		C		D		E				
In. mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.		Lbs.	Kg.
4 100	9.00	229	14.13	359	9.00	229	.94	24	3.66	93		105	48
6 150	10.50	267	18.56	471	11.00	279	1.00	25	3.44	87		170	77
8 200	11.50	292	22.13	562	13.50	343	1.13	29	4.00	102		277	125
10 250	13.00	330	25.75	654	16.00	406	1.19	30	3.88	98		399	181
12 300	14.00	356	29.50	749	19.00	483	1.25	32	4.94	125		623	283

M-609 Dimensions												Weight	
Size	A		B		C		D		E				
In. mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.		Lbs.	Kg.
4 100	9.25	235	14.13	359	9.00	229	1.00	25	3.66	93		100	45
6 150	10.75	273	18.56	471	11.09	282	1.03	26	3.44	87		153	69
8 200	11.50	292	22.13	562	13.31	338	1.09	28	4.00	102		250	113
10 250	13.00	330	25.75	654	15.63	397	1.13	29	3.88	98		390	176
12 300	14.00	356	29.50	749	18.00	457	1.25	32	4.94	125		556	253

FREEZING WEATHER PRECAUTION: Subsequent to testing a piping system, gate valve should be in an open position to allow complete drainage.

NOTE: Number of turns required to open 4", 6", 13½", 8", 17½", 10", 30½", 12", 38½" turns.
Tolerance ± ½ turn on all sizes.


NOTE: Available to ISO Flange dimensions. Specify F-609-I. See page 53.

WARNING: This product can expose you to chemicals including lead, which is known to the State of California to cause cancer and birth defects or other reproductive harm. For more information go to www.P65Warnings.ca.gov.




F-609
Flanged

M-609
Mechanical

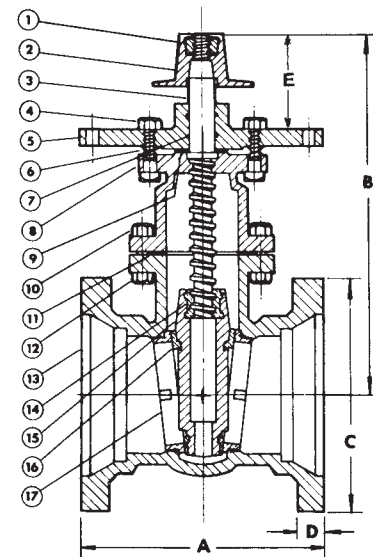

M-609
MJ x MJ

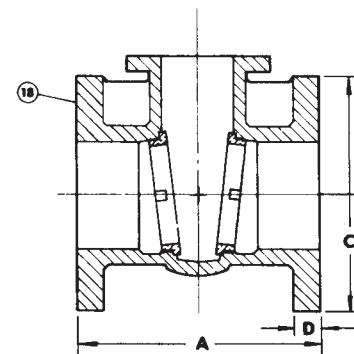

F-609
Flg x Flg

Visit our website for the most current information.