

# Installation Manual

NORITZ AMERICA  
CORPORATION

## CONDENSING TANKLESS GAS WATER HEATER

NRC98-OD (Outdoor Installation) **ecoTOUGH™**  
NRC83-OD Super Efficient. Reliable.

Potential dangers from accidents during installation and use are divided into the following three categories. Closely observe these warnings, they are critical to your safety.



### DANGER

DANGER indicates an imminently hazardous situation which, if not avoided, will result in death or serious injury.



### WARNING

WARNING indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.



### CAUTION

CAUTION indicates a potentially hazardous situation which, if not avoided, may result in minor or moderate injury.

**WARNING:** If the information in this manual is not followed exactly, a fire or explosion may result causing property damage, personal injury or death.



Prohibited



Disconnect  
Power



Ground



Be sure to do



### CAUTION

## Requests to Installers

- In order to use the water heater safely, read this installation manual carefully, and follow the installation instructions.
- Failures and damage caused by erroneous work or work not as instructed in this manual are not covered by the warranty.
- Check that the installation was done properly in accordance with this Installation Manual upon completion.
- After completing installation, please either place this Installation Manual in a plastic pouch and attach it to the side of the water heater (or the inside of the pipe cover or recess box if applicable), or hand it to the customer to retain for future reference. Also, be sure to fill in all of the required items on the warranty and to hand the warranty to the customer along with the Owner's Guide.



Low NOx  
Approved by  
SCAQMD  
14 ng/J or 20 ppm  
(Natural Gas Only)

### FOR USE IN RESIDENTIAL APPLICATIONS.

Installation must conform with local codes, or in the absence of local codes, the National Fuel Gas Code, ANSI Z223.1/NFPA 54- latest edition and/or CSA B149.1, Natural Gas and Propane Installation Code (NSCNGPIC).

Noritz America reserves the right to discontinue, or change at any time, the designs and/or specifications of its products without notice.



SBA8677-2  
Rev. 03/13



\*SBA8677\*





# 1. Included Accessories

The following accessories are included with the unit. Check for any missing items before starting installation.

| Part                          | Shape                                                                             | Q'ty | Part                                                         | Shape                                                                              | Q'ty   |
|-------------------------------|-----------------------------------------------------------------------------------|------|--------------------------------------------------------------|------------------------------------------------------------------------------------|--------|
| Cross Recessed Head Screw     |  | 3    | Owner's Guide, Warranty, Installation Manual (this document) |  | 1 each |
| Remote Controller (See p. 19) |  | 1    | Remote Controller Cord (6ft (2m))                            |  | 1      |

# 2. Optional Accessories

The accessories listed below are not included with the units, but may be necessary for installation.
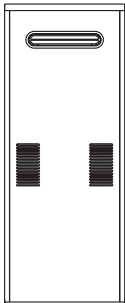
| Part                                              | Shape                                                                              | Q'ty | Part                                   | Shape                                                                                 | Q'ty |
|---------------------------------------------------|------------------------------------------------------------------------------------|------|----------------------------------------|---------------------------------------------------------------------------------------|------|
| Remote Controller Cord (26ft (8m))                |   | 1    | Quick Connect Cord (QC-2)              |     | 1    |
| Isolation Valves (includes pressure relief valve) |   | 1    | Remote Controller Outdoor Junction Box |    | 1    |
| Recess Box (RB-900)                               |  | 1    | Pipe Cover (PC-3S)                     |  | 1    |


# 3. Quick Connect Multi System Installation

- The Quick Connect Multi System allows the installation of two units together utilizing only the Quick Connect Cord.


The Quick Connect Cord is 6 ft.(2m) long. Install the units 2-18" (50 - 457mm) apart from each other to ensure the cord will be able to reach between the units. (See Typical Plumbing diagram). (If the distance between the two units is too great, not only will the cord not be able to reach, but the water temperature may also become unstable because of the difference in pipe length between the two units).

## System Diagram

\* When connecting two units, use only a single remote controller.

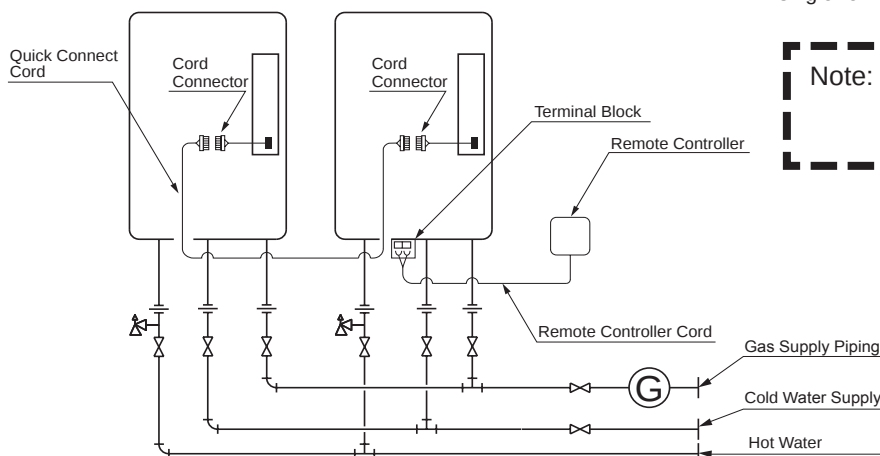

## Typical Plumbing

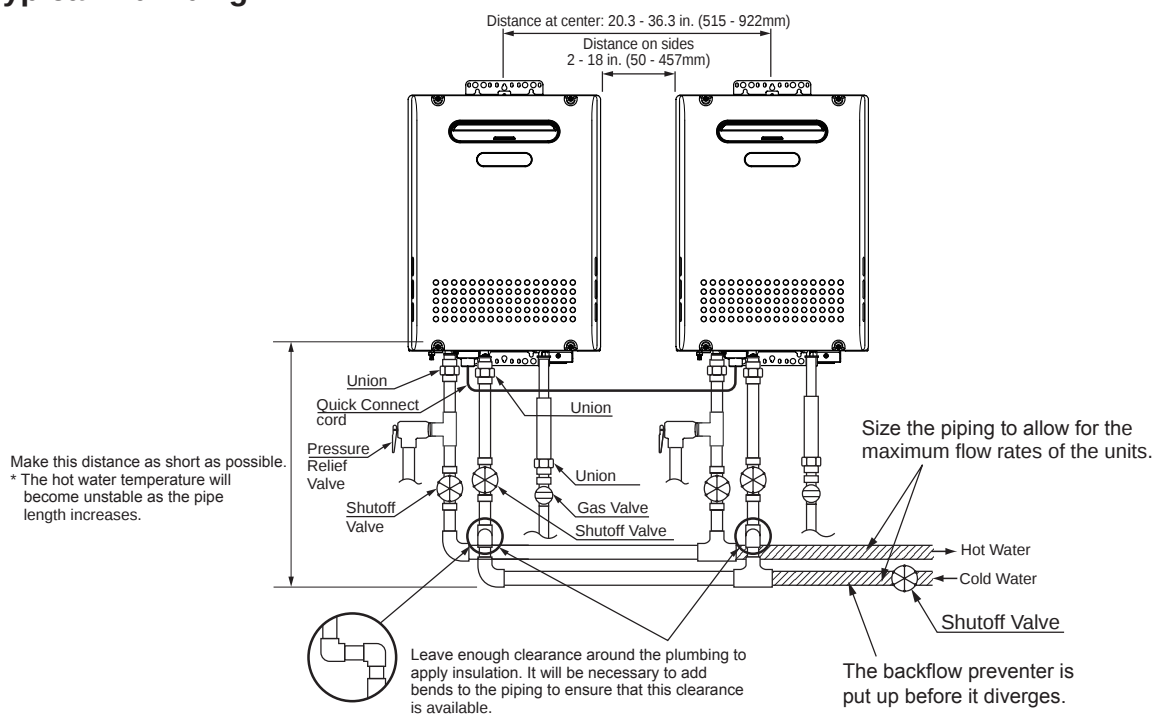

- Insulate the hot water piping to prevent heat loss. Insulate and apply heating materials to the cold water supply piping to prevent heat loss and freezing of pipes when exposed to excessively cold temperatures.

## 4. Before Installation



### WARNING

#### Check the Gas

- Check that the rating plate indicates the correct type of gas.
- Check that the gas supply line is sized for 180,000 Btuh for NRC98-OD, 157,000 Btuh for NRC83-OD.

#### Check the Power

- The power supply required is 120VAC, at 60Hz. May result in fire or electric shock.

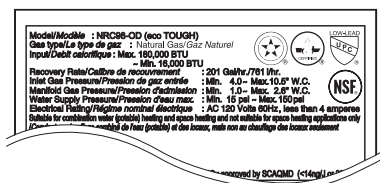

#### Use Extreme Caution if Using With a Solar Pre-Heater

- Using this unit with a solar pre-heater can lead to unpredictable output temperatures and possibly scalding. If absolutely necessary, use mixing valves to ensure output temperatures do not get to scalding levels. Do not use a solar pre-heater with the quick-connect multi-system.

### CAUTION

#### Do Not Use Equipment for Purposes Other Than Those Specified

- Do not use for other than increasing the temperature of the water supply, as unexpected accidents may occur as a result.

#### Check Water Supply Quality

- If the water supply is in excess of 12 grains per gallon (200 mg/L) of hardness, acidic or otherwise impure, treat the water with approved methods in order to ensure full warranty coverage.



## 5. Choosing Installation Site

- \* Locate the appliance in an area where leakage from the unit or connections will not result in damage to the area adjacent to the appliance or to the lower floors of the structure. When such locations cannot be avoided, it is recommended that a suitable drain pan, adequately drained, be installed under the appliance. The pan must not restrict combustion air flow.

### DANGER


- This water heater is for outdoor installation only. Never install it indoors. Do not enclose the termination with corrugated metal or other materials.

This will cause carbon monoxide poisoning and a potential fire hazard.

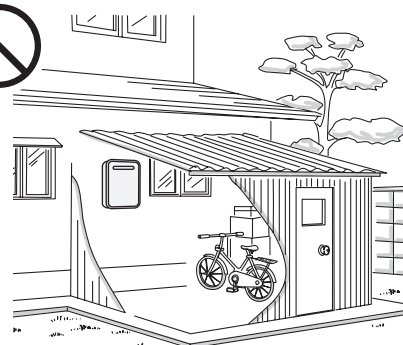

## **WARNING**

- Avoid places where fires are common, such as those where gasoline, benzene and adhesives are handled, or places in which corrosive gases (ammonia, chlorine, sulfur, ethylene compounds, acids) are present.  
Using the incorrect voltage may result in fire or cracking.
- Avoid installation in places where dust or debris will accumulate.  
Dust may block the air-supply opening, causing the performance of the device fan to drop and incomplete combustion to occur as a result.
- Avoid installation in places where special chemical agents (e.g., hair spray or spray detergent) are used.  
Ignition failures and malfunction may occur as a result.
- Carbon Monoxide Poisoning Hazard. Do not install this water heater in a mobile home, recreational vehicle or on a boat.

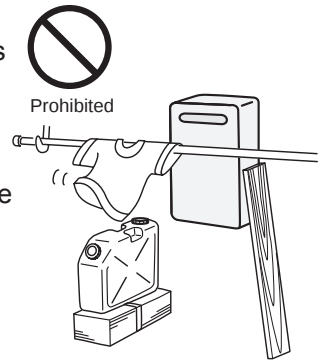

## **CAUTION**

- Install the water heater in a location where it is free from obstacles and stagnant air.
- Consult with the customer concerning the location of installation.
- Do not install the water heater near staircases or emergency exits.
- Do not install the water heater where the exhaust will blow on outer walls or material not resistant to heat. Also consider the surrounding trees and animals.  
The heat and moisture from the water heater may cause discoloration of walls and resinous materials, or corrosion of aluminum materials.
- Do not locate the vent termination directed towards a window or any other structure which has glass or wired glass facing the termination.
- Install in a location where the exhaust gas flow will not be affected by fans or range hoods.
- Take care that noise and exhaust gas will not affect neighbors.  
Avoid installation on common walls as the unit will make some operational noises while it is running.
- Avoid installation where the unit will be exposed to excessive winds.
- Before installing, make sure that the vent termination will have the proper clearances according to the National Fuel Gas Code (ANSI Z223.1).



State of California: The water heater must be braced, anchored or strapped to avoid moving during an earthquake. Contact local utilities for code requirements in your area or call: 1-866-766-7489 and request instructions.

The Commonwealth of Massachusetts:




- 1) The outdoor units (OD) can only be used if they are for summer use only.
- 2) The water heater can be used for hot water only and not in a combination of domestic and space heating.

# 6. Installation Clearances

## WARNING


Before installing, check for the following:

Install in accordance with relevant building and mechanical codes, as well as any local, state or national regulations, or in the absence of local and state codes, to the National Fuel Gas Code ANSI Z223.1/NFPA 54 – latest edition. In Canada, see NSCNGPIC for detailed requirements.
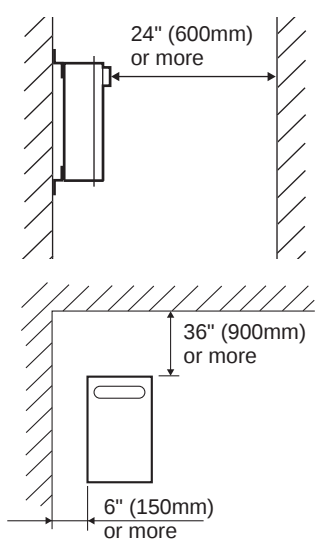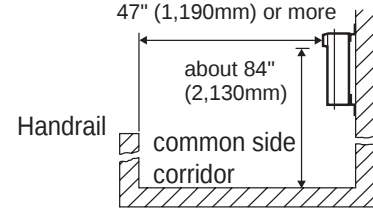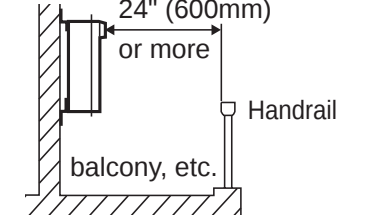
| Item                                 | Check                                                                                                                                                                                                                                                                                                                                                           | Illustration                                                                         |
|--------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------|
| Required Clearances From Heater      | <ul style="list-style-type: none"> <li>Maintain the following clearance from both combustible and non-combustible materials.</li> </ul>                                                                                                                                                                                                                         |   |
| Surrounding the area of installation | <ul style="list-style-type: none"> <li>When installing the unit in a common side corridor, provide a clearance of 47" (1,190mm) or more in front of the unit.</li> <li>Set the bottom edge of the exhaust port about 84" (2,130mm) from the corridor floor.</li> </ul>                                                                                          |  |
|                                      | <ul style="list-style-type: none"> <li>When installing the unit on a balcony, etc., secure an evacuation route of 24" (600mm) or more in width.</li> <li>Provide clearance of 24" (600mm) or more in front of the unit to facilitate inspection and repair. Do install the unit such as the wall of the second floor where the unit is out of reach.</li> </ul> |  |

## Clearance Requirements from Vent Terminations to Building Openings

\* All clearance requirements are in accordance with ANSI Z21.10.3 and the National Fuel Gas Code, ANSI Z223.1 and in Canada, in accordance with NSCNGPIC.

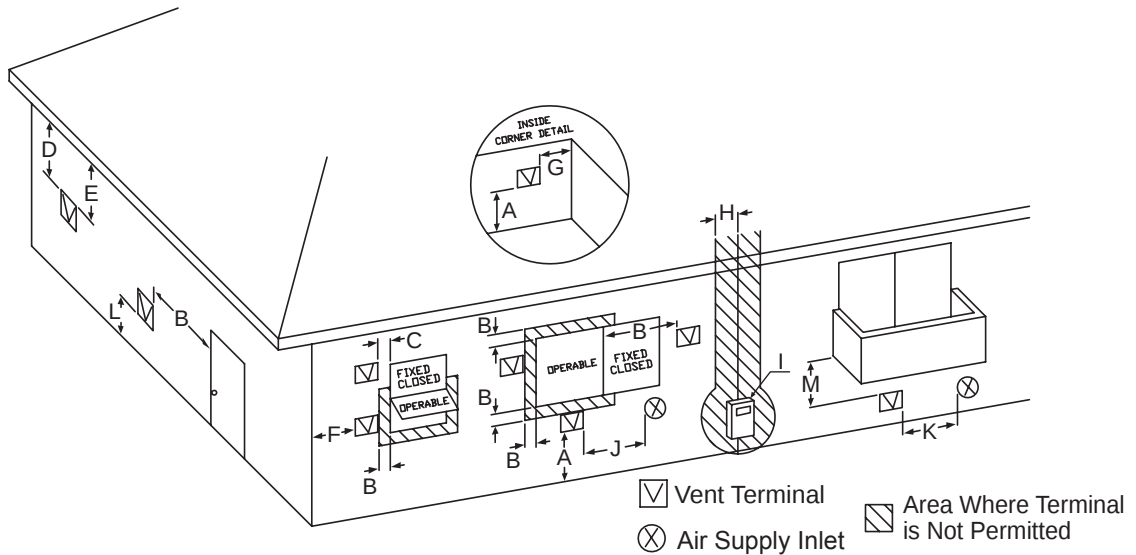

| Ref | Description                                                                                                                                            | Canadian Non-Direct Vent Installations <sup>1</sup>                           | US Non-Direct Vent Installations <sup>2</sup>                        |
|-----|--------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------|----------------------------------------------------------------------|
| A=  | Clearance above grade, veranda, porch, deck, or balcony                                                                                                | 12 in (30 cm)                                                                 | 12 in (30 cm)                                                        |
| B=  | Clearance to window or door that may be opened                                                                                                         | 36 in (91 cm)                                                                 | 4 ft (1.2 m) below or to side of opening; 1 ft (30 cm) above opening |
| C=  | Clearance to permanently closed window                                                                                                                 | *                                                                             | *                                                                    |
| D=  | Vertical clearance to ventilated soffit located above the terminal within a horizontal distance of 2 feet (61 cm) from the center line of the terminal | *                                                                             | *                                                                    |
| E=  | Clearance to unventilated soffit                                                                                                                       | *                                                                             | *                                                                    |
| F=  | Clearance to outside corner                                                                                                                            | *                                                                             | *                                                                    |
| G=  | Clearance to inside corner                                                                                                                             | *                                                                             | *                                                                    |
| H=  | Clearance to each side of center line extended above meter/regulator assembly                                                                          | 3 ft (91 cm) within a height 15 ft (4.5 m) above the meter/regulator assembly | *                                                                    |
| I=  | Clearance to service regulator vent outlet                                                                                                             | 3 ft (91 cm)                                                                  | *                                                                    |
| J=  | Clearance to nonmechanical air supply inlet to building or the combustion air inlet to any other appliance                                             | 36 in (91 cm)                                                                 | 4 ft (1.2 m) below or to side of opening; 1 ft (30 cm) above opening |
| K=  | Clearance to a mechanical air supply inlet                                                                                                             | 6 ft (1.83 m)                                                                 | 3 ft (91 cm) above if within 10 ft (3 m) horizontally                |
| L=  | Clearance above paved sidewalk or paved driveway located on public property                                                                            | 7 ft (2.13 m)†                                                                | *                                                                    |
| M=  | Clearance under veranda, porch, deck, or balcony                                                                                                       | 12 in (30 cm)‡                                                                | *                                                                    |

<sup>1</sup> In accordance with the current CSA B149.1 Natural Gas and Propane Installation Code

<sup>2</sup> In accordance with the current ANSI Z223.1 / NFPA 54 National Fuel Gas Code

† A vent shall not terminate directly above a sidewalk or paved driveway that is located between two single family dwellings and serves both dwellings.

‡ Permitted only if veranda, porch, deck, or balcony is fully open on a minimum of two sides beneath the floor.

\* Clearance in accordance with local installation codes and the requirements of the gas supplier. Clearance to opposite wall is 24 inches (60 cm).

# 7. Installation

## Securing to the wall



Be sure to do

- The weight of the device will be applied to the wall. If the strength of the wall is not sufficient, reinforcement must be done to prevent the transfer of vibration.
- Do not drop or apply unnecessary force to the device when installing. Internal parts may be damaged and may become highly dangerous.
- Install the unit on a vertical wall and ensure that it is level.

| Item                                        | Check                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Illustration                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |
|---------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|---|---|-------------------------|---|---|---------------------------------|---|---|-----------------------------------|---|---|-----------------------------------|---|---|
| Locating Screw Holes                        | <div style="border: 1px solid black; padding: 5px; text-align: center;"> <b>CAUTION</b> </div> <ul style="list-style-type: none"> <li>• When installing with bare hands, take caution to not inflict injury.</li> <li>• Be careful not to hit electrical wiring, gas, or water piping while drilling holes.</li> </ul> <ol style="list-style-type: none"> <li>1. Drill a single screw hole, making sure to hit a stud.</li> <li>2. Insert and tighten the screw and hang the unit by the upper wall mounting bracket.</li> <li>3. Determine the positions for the remaining four screws (two for the top bracket and two for the bottom), and remove the unit.</li> </ol> | <p>Location of Screw Hole</p> <p>Locating Screw Holes</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |
| Mounting                                    | <ol style="list-style-type: none"> <li>4. Drill holes for the remaining four screws.</li> <li>5. Hang the unit again by the first screw, and then insert and tighten the remaining four screws.</li> <li>6. Take waterproofing measures so that water does not enter the building from screws mounting the device.</li> </ol>                                                                                                                                                                                                                                                                                                                                             | <p>Anchoring Screw (Arrangement at the field)</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |
| Structure                                   | <ul style="list-style-type: none"> <li>• Make sure the unit is installed securely so that it will not fall or move due to vibrations or earthquakes.</li> </ul>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |
| Installations at Elevations Above 2,000 ft. | <ul style="list-style-type: none"> <li>• Adjust the dip switches as illustrated in the table to the right if this water heater is installed at an altitude of 2000 ft. (610m) or higher.</li> <li>• Disconnect power to the water heater before changing the dip switches. Failure to perform this step will result in a "73" code displayed on the remote controller and a cease in operation. If this occurs, disconnect, then reconnect power to the water heater to reset the system.</li> </ul> <p>Note : Please refer to page 19 for the location of the dip switch bank.</p>                                                                                       | <p>* Do not change any other dipswitches.</p> <div style="display: flex; align-items: center;"> <div style="margin-right: 10px;"> <p>OFF</p> <p>ON</p> </div> <div> <p>* High elevation adjustment.</p> <table border="1"> <thead> <tr> <th></th><th>5</th><th>6</th></tr> </thead> <tbody> <tr> <td>0 - 2,000 ft (0 - 610m)</td><td style="text-align: center;">○</td><td style="text-align: center;">○</td></tr> <tr> <td>2,001 - 4,000 ft (611 - 1,220m)</td><td style="text-align: center;">●</td><td style="text-align: center;">○</td></tr> <tr> <td>4,001 - 6,000 ft (1,221 - 1,830m)</td><td style="text-align: center;">○</td><td style="text-align: center;">●</td></tr> <tr> <td>6,001 - 8,000 ft (1,831 - 2,440m)</td><td style="text-align: center;">●</td><td style="text-align: center;">●</td></tr> </tbody> </table> <p>ON=● OFF=○</p> </div> </div> <div style="margin-top: 10px;"> </div> |  | 5 | 6 | 0 - 2,000 ft (0 - 610m) | ○ | ○ | 2,001 - 4,000 ft (611 - 1,220m) | ● | ○ | 4,001 - 6,000 ft (1,221 - 1,830m) | ○ | ● | 6,001 - 8,000 ft (1,831 - 2,440m) | ● | ● |
|                                             | 5                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | 6                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |
| 0 - 2,000 ft (0 - 610m)                     | ○                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | ○                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |
| 2,001 - 4,000 ft (611 - 1,220m)             | ●                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | ○                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |
| 4,001 - 6,000 ft (1,221 - 1,830m)           | ○                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | ●                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |
| 6,001 - 8,000 ft (1,831 - 2,440m)           | ●                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | ●                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |  |   |   |                         |   |   |                                 |   |   |                                   |   |   |                                   |   |   |

# 8. Gas Piping

Follow the instructions from the gas supplier.

The appliance and its individual shutoff valve must be disconnected from the gas supply piping system during any pressure testing of that system at test pressures in excess of  $\frac{1}{2}$  psig (3.5 kPa). The Appliance must be isolated from the gas supply piping system by closing its individual manual shut-off valve during any pressure testing of the gas supply piping system at test pressures equal to or less than  $\frac{1}{2}$  psig (3.5 kPa).

The appliance and its gas connections must be leak tested before placing the appliance in operation.

The inlet gas pressure must be within the range specified. This is for the purposes of input adjustment.

In order to choose the proper size for the gas line, consult local codes or the National Fuel Gas Code ANSI Z223.1.

## Gas Pressure

Size the gas line according to total btuh demand of the building and length from the meter or regulator so that the following supply pressures are available even at maximum demand:

### Natural Gas Supply Pressure

Min. 4" WC  
Max. 10.5" WC

### LP Gas Supply Pressure

Min. 8" WC  
Max. 14" WC

## Gas Meter

Select a gas meter capable of supplying the entire btuh demand of all gas appliances in the building.


## Gas Connection

- Do not use piping with a diameter smaller than the inlet diameter of the water heater.
- Gas flex lines are not recommended unless they are rated for 180,000 btuh(NRC98-OD), 157,000 btuh(NRC83-OD).
- Install a gas shutoff valve on the supply line.
- Use only approved gas piping materials.


## Measuring Gas Pressure

In order to check the gas supply pressure to the unit, a tap is provided on the gas inlet. Remove the hex head philips screw from the tap, and connect a manometer using a silicon tube.

In order to check the gas manifold pressure, a pair of taps are provided on the gas valve inside the unit. The pressure can be checked either by removing the hex head philips screw and connecting a manometer with a silicon tube, or by removing the 1/8" NPT screw with an allen wrench and connecting the appropriate pressure gauge.

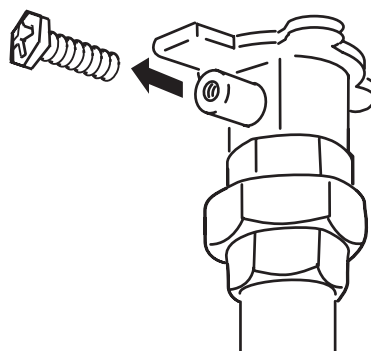

## Sample Gas Line

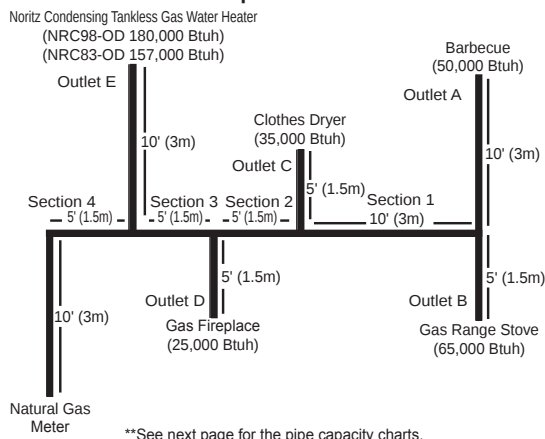

\*\*See next page for the pipe capacity charts.

## Instructions

- Size each outlet branch starting from the furthest using the Btuh required and the length from the meter.
- Size each section of the main line using the length to the furthest outlet and the Btuh required by everything after that section.

## Sample Calculation

Outlet A: 45' (13.5m) (Use 50' (15m)), 50,000 Btuh requires 1/2"  
 Outlet B: 40' (12m), 65,000 Btuh requires 1/2"  
 Section 1: 45' (13.5m) (Use 50' (15m)), 115,000 Btuh requires 3/4"  
 Outlet C: 30' (9m), 35,000 Btuh requires 1/2"  
 Section 2: 45' (13.5m) (Use 50' (15m)), 150,000 Btuh requires 3/4"  
 Outlet D: 25' (7.5m) (Use 30' (9m)), 25,000 Btuh requires 1/2"  
 Section 3: 45' (13.5m) (Use 50' (15m)), 175,000 Btuh requires 1"  
 Outlet E: 25' (7.5m) (Use 30' (9m)), 180,000 Btuh requires 3/4" (NRC98-OD), 157,000 Btuh requires 3/4" (NRC83-OD)  
 Section 4: 45' (13.5m) (Use 50' (15m)), 355,000 Btuh requires 1-1/4"

# Gas Line Sizing for a Noritz Condensing Tankless Gas Water Heater

Adapted from UPC 1997

Maximum **Natural Gas** Delivery Capacity in Cubic Feet per Hour (0.60 Specific Gravity, 0.5" WC Pressure Drop)

| Pipe Size | Length in Feet |          |          |           |           |           |           |           |           |            |              |
|-----------|----------------|----------|----------|-----------|-----------|-----------|-----------|-----------|-----------|------------|--------------|
|           | 10' (3m)       | 20' (6m) | 30' (9m) | 40' (12m) | 50' (15m) | 60' (18m) | 70' (21m) | 80' (24m) | 90' (27m) | 100' (30m) | 125' (37.5m) |
| 1/2"      | 174            | 119      | 96       | 82        | 73        | 66        | 61        | 56        | 53        | 50         | 44           |
| 3/4"      | 363            | 249      | 200      | 171       | 152       | 138       | 127       | 118       | 111       | 104        | 93           |
| 1"        | 684            | 470      | 377      | 323       | 286       | 259       | 239       | 222       | 208       | 197        | 174          |
| 1 1/4"    | 1404           | 965      | 775      | 663       | 588       | 532       | 490       | 456       | 428       | 404        | 358          |
| 1 1/2"    | 2103           | 1445     | 1161     | 993       | 880       | 798       | 734       | 683       | 641       | 605        | 536          |
| 2"        | 4050           | 2784     | 2235     | 1913      | 1696      | 1536      | 1413      | 1315      | 1234      | 1165       | 1033         |
| 2 1/2"    | 6455           | 4437     | 3563     | 3049      | 2703      | 2449      | 2253      | 2096      | 1966      | 1857       | 1646         |
| 3"        | 11,412         | 7843     | 6299     | 5391      | 4778      | 4329      | 3983      | 3705      | 3476      | 3284       | 2910         |
| 3 1/2"    | 16,709         | 11,484   | 9222     | 7893      | 6995      | 6338      | 5831      | 5425      | 5090      | 4808       | 4261         |
| 4"        | 23,277         | 15,998   | 12,847   | 10,995    | 9745      | 8830      | 8123      | 7557      | 7091      | 6698       | 5936         |

Contact the Gas Supplier for Btu/Cubic Ft. of the Supplied Gas. 1000 BTU/Cubic Ft. is a Typical Value

Maximum **Liquefied Petroleum** (Undiluted) Delivery Capacity in Thousands of Btuh (0.5" WC Pressure Drop)

| Pipe Size | Length in Feet |          |          |           |           |           |           |           |           |            |              |            |            |
|-----------|----------------|----------|----------|-----------|-----------|-----------|-----------|-----------|-----------|------------|--------------|------------|------------|
|           | 10' (3m)       | 20' (6m) | 30' (9m) | 40' (12m) | 50' (15m) | 60' (18m) | 70' (21m) | 80' (24m) | 90' (27m) | 100' (30m) | 125' (37.5m) | 150' (45m) | 200' (60m) |
| 1/2"      | 275            | 189      | 152      | 129       | 114       | 103       | 96        | 89        | 83        | 78         | 69           | 63         | 55         |
| 3/4"      | 567            | 393      | 315      | 267       | 237       | 217       | 196       | 185       | 173       | 162        | 146          | 132        | 112        |
| 1"        | 1071           | 732      | 590      | 504       | 448       | 409       | 378       | 346       | 322       | 307        | 275          | 252        | 213        |
| 1 1/4"    | 2205           | 1496     | 1212     | 1039      | 913       | 834       | 771       | 724       | 677       | 630        | 567          | 511        | 440        |
| 1 1/2"    | 3307           | 2299     | 1858     | 1559      | 1417      | 1275      | 1181      | 1086      | 1023      | 976        | 866          | 787        | 675        |
| 2"        | 6221           | 4331     | 3465     | 2992      | 2646      | 2394      | 2205      | 2047      | 1921      | 1811       | 1606         | 1496       | 1260       |

\*\* For reference only. Please consult gas pipe manufacturer for actual pipe capacities.

Maximum Capacity of Flex TracPipe® in Cubic Feet per Hour of **Natural Gas** (0.60 Specific Gravity, 0.5" WC Pressure Drop)

| Pipe Size | Length in Feet |          |          |           |           |           |           |           |           |            |            |            |
|-----------|----------------|----------|----------|-----------|-----------|-----------|-----------|-----------|-----------|------------|------------|------------|
|           | 10' (3m)       | 20' (6m) | 30' (9m) | 40' (12m) | 50' (15m) | 60' (18m) | 70' (21m) | 80' (24m) | 90' (27m) | 100' (30m) | 150' (45m) | 200' (60m) |
| 3/4"      | 206            | 147      | 121      | 105       | 94        | 86        | 80        | 75        | 71        | 67         | 55         | 48         |
| 1"        | 383            | 269      | 218      | 188       | 168       | 153       | 141       | 132       | 125       | 118        | 94         | 82         |
| 1 1/4"    | 614            | 418      | 334      | 284       | 251       | 227       | 209       | 194       | 181       | 171        | 137        | 116        |
| 1 1/2"    | 1261           | 888      | 723      | 625       | 559       | 509       | 471       | 440       | 415       | 393        | 320        | 277        |
| 2"        | 2934           | 2078     | 1698     | 1472      | 1317      | 1203      | 1114      | 1042      | 983       | 933        | 762        | 661        |

Maximum Capacity of Flex TracPipe® in Thousands of Btuh **Liquefied Petroleum** ( 0.5" WC Pressure Drop)

| Pipe Size | Length in Feet |          |          |           |           |           |           |           |           |            |            |            |
|-----------|----------------|----------|----------|-----------|-----------|-----------|-----------|-----------|-----------|------------|------------|------------|
|           | 10' (3m)       | 20' (6m) | 30' (9m) | 40' (12m) | 50' (15m) | 60' (18m) | 70' (21m) | 80' (24m) | 90' (27m) | 100' (30m) | 150' (45m) | 200' (60m) |
| 3/4"      | 325            | 232      | 191      | 166       | 149       | 136       | 126       | 118       | 112       | 106        | 87         | 76         |
| 1"        | 605            | 425      | 344      | 297       | 265       | 241       | 222       | 208       | 197       | 186        | 143        | 129        |
| 1 1/4"    | 971            | 661      | 528      | 449       | 397       | 359       | 330       | 307       | 286       | 270        | 217        | 183        |
| 1 1/2"    | 1993           | 1404     | 1143     | 988       | 884       | 805       | 745       | 696       | 656       | 621        | 506        | 438        |
| 2"        | 4638           | 3285     | 2684     | 2327      | 2082      | 1902      | 1761      | 1647      | 1554      | 1475       | 1205       | 1045       |

\*\* For reference only. Please consult gas pipe manufacturer for actual pipe capacities.

TracPipe® is a registered trademark of Omega Flex.

Maximum Capacity for Gas Flex Connectors in Cubic Feet per Hour of **Natural Gas** (0.60 Specific Gravity, 0.5" WC Pressure Drop)

| Pipe Size | Length in Inches |             |             |              |              |              |
|-----------|------------------|-------------|-------------|--------------|--------------|--------------|
|           | 12" (300mm)      | 24" (600mm) | 36" (900mm) | 48" (1200mm) | 60" (1500mm) | 72" (1800mm) |
| 1/2"      | 180              | 150         | 125         | 106          | 93           | 86           |
| 3/4"      | —                | 290         | 255         | 215          | 197          | 173          |
| 1"        | —                | 581         | 512         | 442          | 397          | 347          |
| 1 1/4"    | —                | 1470        | 1200        | 1130         | 960          | 930          |

Maximum Capacity for Gas Flex Connectors in Thousands of Btuh **Liquefied Petroleum** ( 0.5" WC Pressure Drop)

| Pipe Size | Length in Inches |             |             |              |              |              |
|-----------|------------------|-------------|-------------|--------------|--------------|--------------|
|           | 12" (300mm)      | 24" (600mm) | 36" (900mm) | 48" (1200mm) | 60" (1500mm) | 72" (1800mm) |
| 1/2"      | 288              | 240         | 200         | 169          | 149          | 137          |
| 3/4"      | —                | 465         | 409         | 344          | 315          | 278          |
| 1"        | —                | 930         | 825         | 708          | 638          | 556          |
| 1 1/4"    | —                | 2352        | 1920        | 1808         | 1536         | 1488         |

\*\* For reference only. Please consult gas pipe manufacturer for actual pipe capacities.

# 9. Water Piping

Installation and service must be performed by a qualified plumber. In the Commonwealth of Massachusetts, this product must be installed by a licensed plumber or gas fitter in accordance with the Massachusetts Plumbing and Fuel Gas Code 248 CMR Sections 2.00 and 5.00. Observe all applicable codes.

This appliance is suitable for combination potable water and space heating applications. It cannot be used for space heating applications only. Do not use this appliance if any part has been underwater. Immediately call a qualified service technician to inspect the appliance and replace any part of the control system and gas control which has been under water.

If the water heater is installed in a closed water supply system, such as one having a backflow preventer in the cold water supply line, means shall be provided to control thermal expansion. Contact the water supplier or a local plumbing inspector on how to control this situation.

A pressure relief valve must be installed near the hot water outlet that is rated in accordance with and complying with either The Standard for Relief Valves and Automatic Shutoff Devices for Hot Water Supply Systems, ANSI Z21.22, or The ANSI/ASME Boiler and Pressure Vessel Code, Section IV ( Heating Boilers ). This pressure relief valve must be capable of an hourly Btu rated temperature steam discharge of 180,000 Btuh(NRC98-OD), 157,000 Btuh(NRC83-OD). Multiple valves may be used. The pressure relief capacity must not exceed 150 psig. No valve shall be placed between the relief valve and the water heater. The relief valve must be installed such that the discharge will be conducted to a suitable place for disposal when relief occurs. No reducing coupling or other restriction may be installed in the discharge line. The discharge line must be installed to allow complete drainage of both the valve and the line. If this unit is installed with a separate storage vessel, the separate vessel must have its own temperature and pressure relief valve. This valve must also comply with The Standard for Relief Valves and Automatic Gas Shutoff Devices for Hot Water Supply Systems, ANSI Z21.22. (in the U.S. only). A temperature relief valve is not required, but if one is used, do not install the valve with the probe directly in the flow of water. This may cause unwarranted discharge of the valve.

Piping and components connected to the water heater shall be suitable for use with potable water.

Toxic chemicals, such as those used for boiler treatment, shall not be introduced into the potable water.

A water heater used to supply potable water may not be connected to any heating system or components previously used with a nonpotable water heating appliance.


When water is required in one part of the system at a higher temperature than in the rest of the system, means such as a mixing valve shall be installed to temper the water to reduce the scald hazard.

- Flush water through the pipe to clean out metal powder, sand and dirt before connecting it.
- Perform the following insulation measures for prevention of freezing.
  - Take appropriate heat insulation measures (e.g., wrapping with heat insulation materials, using electric heaters) according to the climate of the region to prevent the pipe from freezing.
  - Make sure that there are no water leaks from the cold and hot water supply pipes, then insulate the pipes completely.
  - Be sure to also completely insulate the water supply valve and the cold and hot water connections on the water heater (refer to the figure on the right).
  - Do not cover the water drain plug with insulation so that water in the pipe can be drained. (Refer to the figure in the right.)
- Use a union coupling or flexible pipe for connecting the pipes to reduce the force applied to the piping.
- Do not use piping with a diameter smaller than the coupling.
- When feed water pressure is too high, insert a depressurizing valve, or take water hammer prevention measure.
- Avoid using joints as much as possible to keep the piping simple.
- Avoid piping in which an air holdup can occur.
- If installing the unit on a roof:
  - About lower-level hot water supply

If the unit is installed on a roof to supply water to the levels below, make sure that the water pressure supplied to the unit does not drop below 29 psi. It may be necessary to install a pump system to ensure that the water pressure is maintained at this level.

Check the pressure before putting the unit into operation.

Failure to supply the proper pressure to the unit may result in noisy operation, shorter lifetime of the unit, and may cause the unit to shut down frequently.

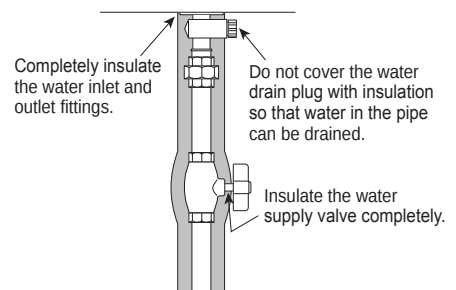

**Supply water piping**

- Do not use PVC, iron, or any piping which has been treated with chromates, boiler seal or other chemicals.
- Mount a check valve and a shut off valve (near the inlet).
- In order for the client to use the water heater comfortably, 98.1 to 491 kPa (14 to 70 PSI) of pressure is needed from the water supply. Be sure to check the water pressure. If the water pressure is low, the water heater cannot perform to its full capability, and may become a source of trouble for the client.

**Drain piping**

- Expansion water may drop from the pressure relief valve and wet the floor. If necessary, provide drain piping or use a drain hose to remove the water.

**Hot water piping**

- Do not use lead, PVC, iron or any piping which has been treated with chromates, boiler seal or other chemicals.
- The longer the piping, the greater the heat loss. Try to make the piping as short as possible.
- Use mixing valves with low water resistance. Use shower heads with low pressure loss.
- If necessary, use a pump or other means to ensure that the supply water pressure to the inlet of the heater does not fall below 29 PSI when the maximum amount of water is being demanded. Also install a pressure meter on the inlet. If this is not done, local boiling will occur inside the water heater causing abnormal sounds and decreasing the durability of the heat exchanger.

**Freeze Prevention**

- Freezing is prevented within the device automatically unless the outside temperature without wind is below -4°F (-20°C) for NRC98-OD, NRC83-OD.
- If this model is installed in an area where the outside temperature can approach freezing conditions of -4°F (-20°C) or below for NRC98-OD, NRC83-OD, then additional freeze protection measures must be used. For temporary freeze protection measures, refer to the Owner's Guide.
- The freeze prevention heaters will not prevent the plumbing external to the unit from freezing. Protect this plumbing with insulation, heat tape or electric heaters, solenoids, or pipe covers.
- In order for the freeze prevention heaters to operate, the water heater must have power at all times.

## Water Treatment

This water heater is equipped with an optional automatic service reminder function to alert the user when flushing or a cartridge/filter change is required. Once activated, the unit will display an "05" error code on the remote controller when maintenance is due. The service interval can be set for either 6, 12, or 24 months; refer to page 14 for recommended flushing intervals. If a water treatment device is installed, refer to the instructions provided with the device for suggested service intervals. By default, the service reminder function is disabled.

To activate or adjust the service reminder error "05", refer to the below procedures.

Note: The setting must be done within the first 10 minutes of connecting electrical power to the water heater.

### Setting Procedure:

1. Turn the water heater off by pressing the Power On/Off Button on the remote controller.
2. Disconnect, then reconnect electrical power to the water heater.
3. Press Setting Button "▲" or "▼" within 10 minutes of connecting electrical power until the remote controller displays "99".
4. Press Setting Button "▲" or "▼" until the remote controller displays "2C".
5. Press the Flow Meter Alarm Set Button for more than 0.5 seconds to switch between ON and OFF.  
"oF" PRIORITY LED goes out  
"on" PRIORITY LED blinks
6. If "2D" also needs to be changed, repeat steps 4 and 5.
7. To confirm the settings, press the Setting Buttons "▲" and "▼" simultaneously for more than 5 seconds. After the settings are confirmed, the maintenance writer mode will end and the remote controller display will disappear.

|            | 2D | 2C |
|------------|----|----|
| No warning | ○  | ○  |
| 6 months   | ○  | ●  |
| 12 months  | ●  | ○  |
| 24 months  | ●  | ●  |

\*Initial factory setting.

ON= ● OFF= ○

Reset the display of the operation panel in the following way after the water heater is serviced.

When the "05" error code appears, reset the display only after the water heater is flushed and/or the water treatment device is serviced.

If the error is reset without performing the necessary service, the water heater may fail prematurely.

Note : In the case of Quick connect multi system, perform scale cleaning of both units.


### How to reset the scale warning:

1. Set the Power On/Off Button to the OFF position.
2. Push the Flow Meter Alarm Set Button more than 2 seconds.
3. Push the Flow Meter Alarm Set Button several times until "7 oF" is displayed.
4. Press Setting Button "▲" more than 5 seconds.  
This will complete the service warning reset.
5. Push the Power On/Off Button.
6. The preset temperature is displayed.



Press setting button "▲" more than 5 seconds. At this time, a sound is emitted from the operation panel.

Push the Power On/Off Button.

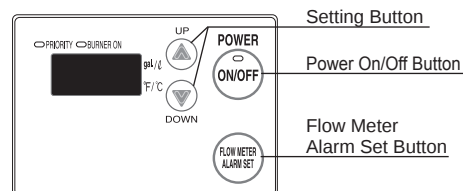

If this water heater will be installed in an application where the supply water is hard, the water must be treated with either the Noritz H2Flow or ScaleShield or a water softener. Refer to the below tables for suggested treatment and maintenance measures to be taken based on the water hardness level. Damage to the water heater as a result of water in excess of 12 gpg (200 mg/L) of hardness is not covered by the Noritz America Limited Warranty.

Note: Water softeners may be regulated by the local water jurisdiction, consult with the manufacturer for code, sizing, and installation guidelines; the below diagram is for reference only. For more information about H2Flow and ScaleShield, contact Noritz America at 866-766-7489.

Residential Use Treatment Guidelines


| Type of Water   | Hardness Level              | Treatment Device      | Flush Frequency*   |
|-----------------|-----------------------------|-----------------------|--------------------|
| Soft            | 0-1 gpg<br>(0-17 mg/L)      | None                  | None               |
| Slightly Hard   | 1-3 gpg<br>(17-51 mg/L)     | None                  | None               |
| Moderately Hard | 3-7 gpg<br>(51-120 mg/L)    | H2Flow or ScaleShield | Once a Year**      |
| Hard            | 7-10 gpg<br>(120-171 mg/L)  | H2Flow or ScaleShield | Once a Year**      |
| Very Hard       | 10-14 gpg<br>(171-239 mg/L) | H2Flow                | Treatment Required |
| Extremely Hard  | > 14 gpg<br>(> 239 mg/L)    | H2Flow                | Treatment Required |

Commercial Use Treatment Guidelines

| Type of Water   | Hardness Level              | Treatment Device | Flush Frequency*   |
|-----------------|-----------------------------|------------------|--------------------|
| Soft            | 0-1 gpg<br>(0-17 mg/L)      | None             | None               |
| Slightly Hard   | 1-3 gpg<br>(17-51 mg/L)     | None             | None               |
| Moderately Hard | 3-7 gpg<br>(51-120 mg/L)    | H2Flow Suggested | Once a Year **     |
| Hard            | 7-10 gpg<br>(120-171 mg/L)  | H2Flow Suggested | Twice a Year**     |
| Very Hard       | 10-14 gpg<br>(171-239 mg/L) | H2Flow           | Treatment Required |
| Extremely Hard  | > 14 gpg<br>(> 239 mg/L)    | H2Flow           | Treatment Required |

\* Install Noritz Isolation Valves to allow for flushing.  
 \*\* Flushing is required if a water treatment device is not installed.

\* Install Noritz Isolation Valves to allow for flushing.  
 \*\* Flushing is required if a water treatment device is not installed.

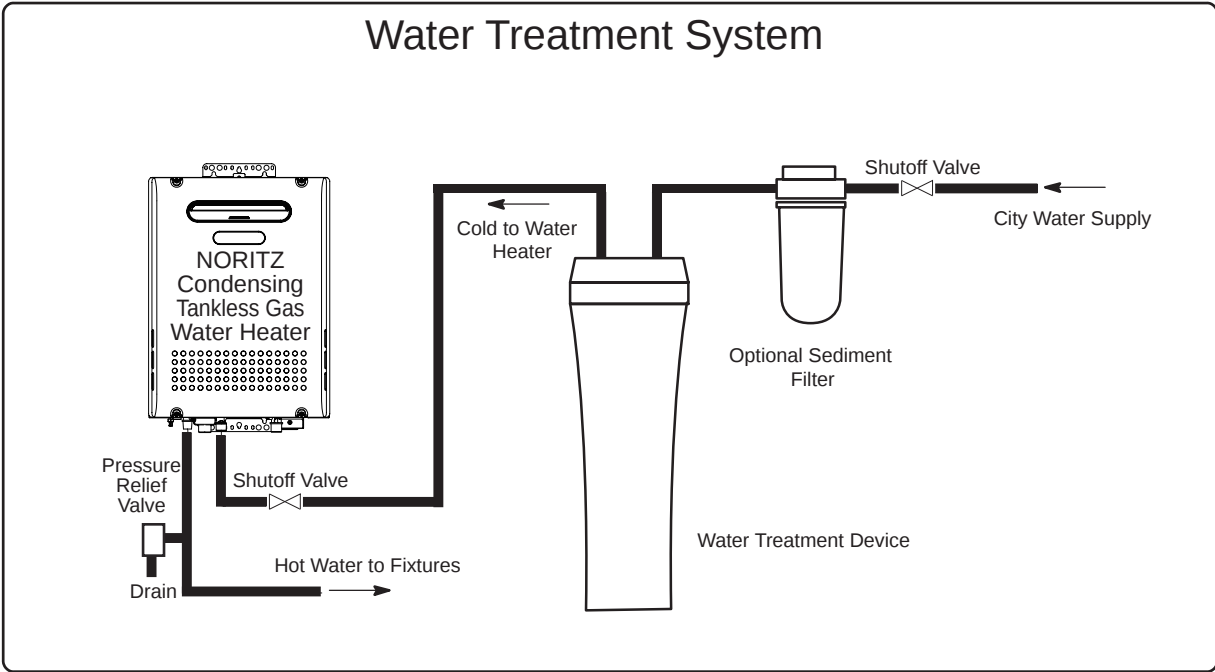


# 10. Condensate Piping




## CAUTION

Due to the acidic nature of the condensate, be sure to properly drain and if necessary, treat the condensate prior to disposal. Damage caused by improperly handled condensate is not covered by the warranty.


- This water heater is a high efficiency, fully condensing appliance which produces acidic condensate during operation. The water heater incorporates a collection and removal system which must be properly drained in order to ensure proper operation of this appliance.
- The pH level of the condensate is approximately 2-3. An external neutralizer must be installed on the drain piping prior to disposal when required by local code or when the condensate could cause damage.
- If an external neutralizer is installed, periodic replacement of the neutralizing agent will be required. Refer to the instructions supplied with the neutralizer for suggested replacement intervals.
- In order to drain the condensate, a 1/2" threaded fitting is provided at the base of the water heater. Do not reduce the size of this fitting or the drain piping to less than 1/2". In cold climates, do not drain the condensate to the outdoors. If the drain pipe freezes during cold weather, the pipe will not drain condensate and the unit will stop operating.
- Use plastic pipe, such as PVC, for the drain line. Do not use steel, black iron, or any other material which can corrode when placed into contact with acidic condensate.
- Keep the length of the drain pipe as short as possible. Long runs or applications where the nearest drain is above the water heater will require the use of a condensate pump. Size the pump to allow for a maximum condensate discharge of 2 GPH from the water heater.
- Horizontal runs must be sloped 1/4" per foot towards the drain or condensate pump. The condensate will be discharged by gravity force only. Make the drain pipe run as short as possible.
- The end of the drain pipe must not be submerged in water or blocked in any way. To ensure proper drainage, leave the end of the drain pipe open to the atmosphere. Do not have a trap. Also, make sure that there are no obstructions blocking the drain line from discharging condensate.
- Be sure to check that condensate is freely flowing from the drain piping after the system has been installed. Condensate will begin flowing out of the water heater within 15 minutes after operation has started.
- Take measures to prevent the condensate drain lines from freezing (insulation, heat tape, electric heaters, etc.).

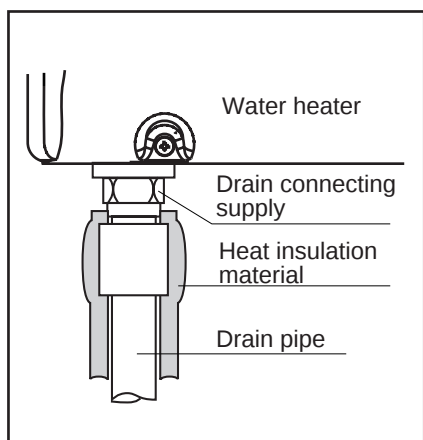


■ Do not pitch the drain line up once a horizontal section has been introduced. Always pitch the drain line down to ensure proper drainage.

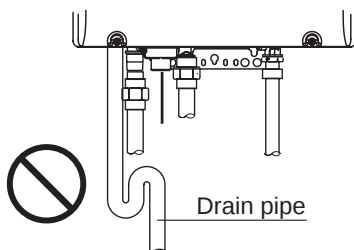

### Condensate piping to floor drain

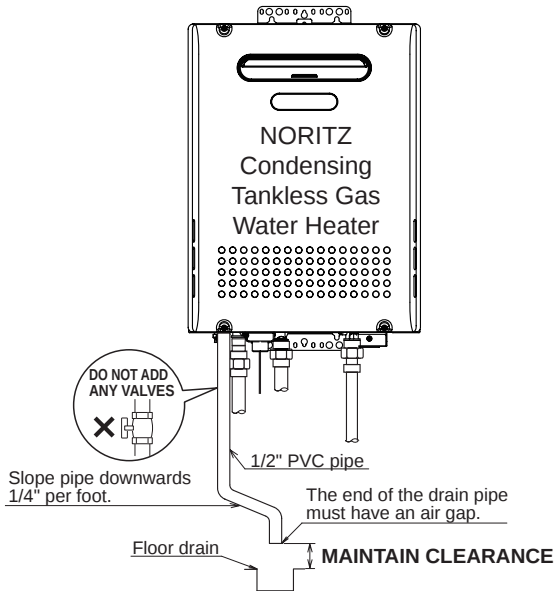

### Condensate piping with pump

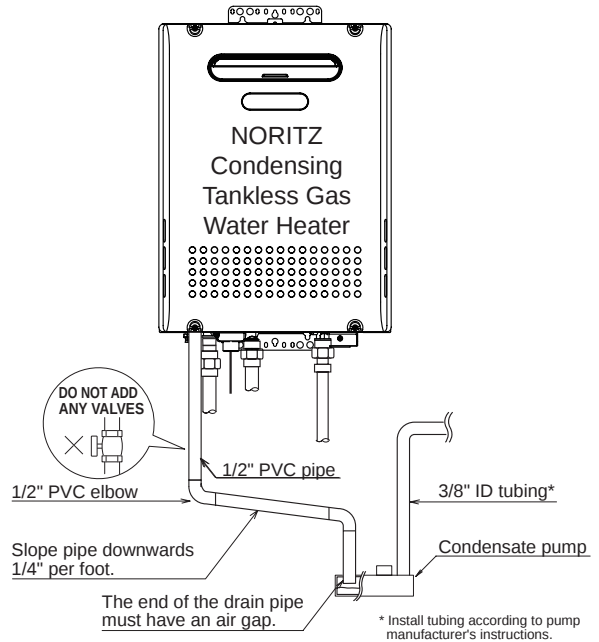

#### Note:



If the drain line becomes clogged or frozen, condensate will back-up into the water heater and a "29" error code will flash on the remote controller, ceasing operation. If this occurs, clear the clog or freeze so that condensate can freely flow. Be sure to slope the drain pipe, use the appropriate size pipe, allow the proper clearances, and apply freeze prevention measures (when necessary) to prevent the drain line from clogging or freezing.

# 11. Plumbing Applications

## Recirculation System

### Notes:


1. Size the pump to provide a maximum of 2 GPM (7.5 L/min.) through the system at 10 ft (3m) of head plus piping losses.  
Adjust the flow using a globe valve and verify the flow rate with the maintenance monitors.
2. Pump Control Signal is the preferred method to control the recirculation pump.  
For pumps larger than 85W, a relay connection must be used. If the Pump Control Signal is not used, an Aquastat may be used to control the pump.
3. Use an Aquastat if the water heater is not controlling the pump.  
Set the Aquastat to 10°F (5°C) below the set output temperature.
4. Noritz recommends the use of an Isolation Kit with the installation.  
These kits include an integrated shut-off and service valve with unions and a pressure relief valve.

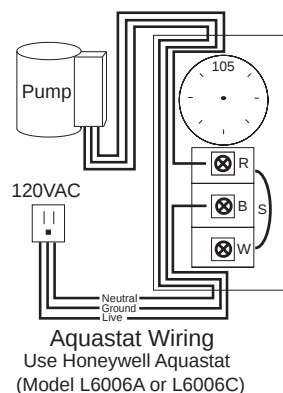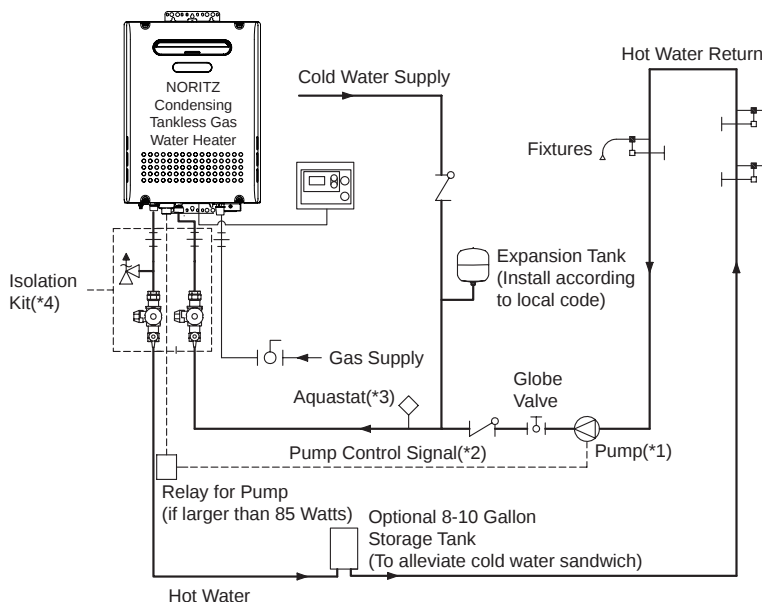

## Combination Potable Water and Space Heating System

### Notes:

1. Noritz recommends the use of an Isolation Kit with the installation.  
These kits include an integrated shut-off and service valve with unions and a pressure relief valve.
2. Size the pump to provide a maximum of 3 GPM (11.3 L/min.) with a head pressure equal to the loss through the water heater and Air Handler.
3. Check valve required if it is not included with the pump.
4. Set the flow switch to deactivate the Air Handler when the domestic hot water flow reaches 3 GPM (11.3 L/min.).  
Adjust as necessary to prevent cycling.
5. If the system requires water for space heating at a higher temperature than for other uses, means such as a mixing valve shall be provided to temper the water for the other uses to help prevent scalding.
6. Expansion tank required if a backflow preventer is installed.
7. The water heater cannot be used for space heating applications only.

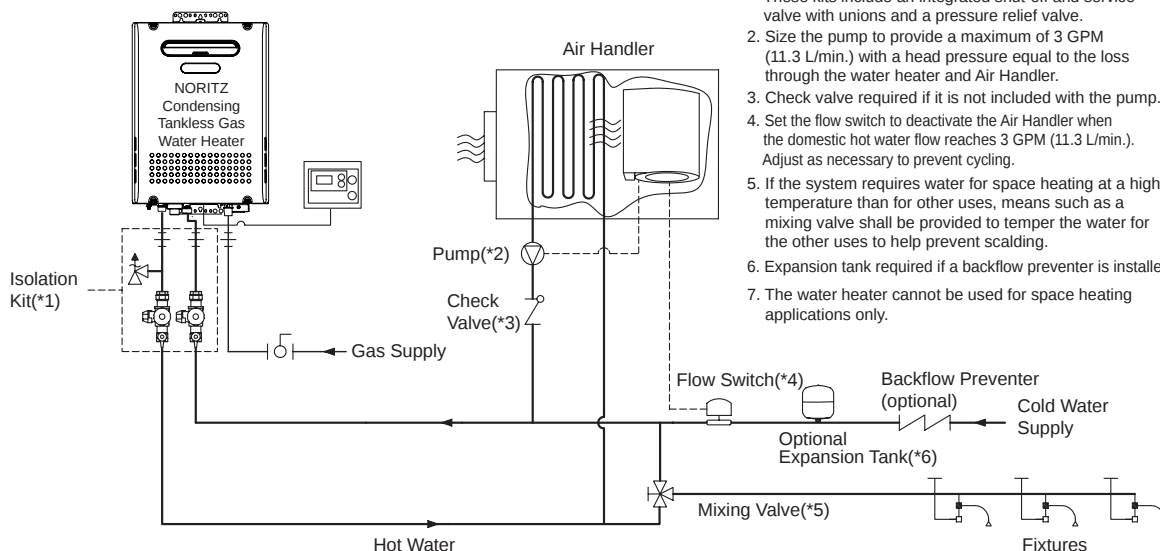

# 12. Electrical Wiring

Consult a qualified electrician for the electrical work.



Disconnect Power

Do not connect electrical power to the unit until all electrical wiring has been completed.

This appliance must be electrically grounded in accordance with local codes, or in the absence of local codes, with the National Electrical Code, ANSI/NFPA 70. In Canada, the latest CSA C22.1 Electrical Code.

**Caution:** Label all wires prior to disconnection when servicing controls. Wiring errors can cause improper and dangerous operation.

Verify proper operation after servicing.

Field wiring to be performed at time of appliance installation.



## WARNING

### Electrical Shock Hazard

Do not turn power on until electrical wiring is finished. Disconnect power before servicing.

Failure to do so may result in death or serious injury from electrical shock.

- The electrical supply required by the water heater is 120VAC at 60 Hz. The power consumption may be up to 271W (NRC98-OD), 257W (NRC83-OD) or higher if using optional accessories. Use an appropriate circuit.
- Do not disconnect the power supply when not in use. When the power is off, the freeze prevention in the water heater will not activate, resulting in possible freezing damage.

- Do not let the power cord contact the gas piping.

Tie the redundant power cord outside the water heater. Putting the redundant length of cord inside the water heater may cause electrical interference and faulty operation.


### Ground

- To prevent electrical shock, provide a ground with resistance less than  $100\Omega$ . An electrician should do this work.
- A grounding screw is provided on the back in the junction box.

Do not connect the ground to the city water or gas piping. Do not tie the ground to a telephone line.

### Breaker Installation

- Mount a device which shuts off the electrical path automatically (leakage breaker) when electrical leakage is detected.

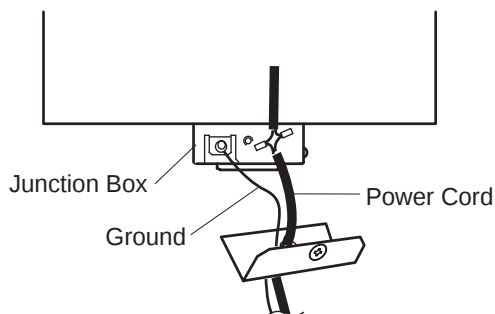

1. Remove the screw (one) of the junction box and open the cover of the junction box.
2. Connect the grounding wire to the ground screw in the cover.
3. Crimp the outdoor power cable to the power cable of the unit.



## CAUTION

Electrostatic discharge can affect electronic components. Take precautions to prevent electrostatic discharges from personnel or hand tools during the water heater installation and servicing to protect product's electronic control.

## Remote Controller

### • Applicable Model


|                                             |          |
|---------------------------------------------|----------|
| Noritz Condensing Tankless Gas Water Heater |          |
| Remote controller                           | RC-7651M |

\* Remarks [125 °F / 55 °C]

↑ Celsius display mode  
↑ Fahrenheit display mode

Install the remote controller according to the instructions in the Installation Guide (p. 26).

- \* Only one remote controller can be connected to the water heater.  
A malfunction may occur if two or more remote controllers are connected.
  - \* The water heater has been factory set to allow a maximum temperature setting of [120 °F / 50 °C].  
To access higher temperature settings through the remote controller, follow the below steps.
- <When setting the maximum temperature to [125 -140 °F / 55 - 60 °C]>
1. Turn the water heater off by pressing the Power On/Off Button on the remote controller.
  2. Press and hold the FLOW METER ALARM SET Button until a sound is heard (2 sec.) and [120 °F / 50 °C] appears on the display.
  3. Set the upper limit of the hot-water supply temperature to [125 °F, 130 °F, 135 °F or 140 °F / 55 °C or 60 °C] using the UP and DOWN setting Buttons.
  4. To put the water heater back into operation, press the Power On/Off Button on the remote controller.  
To keep the water heater off, let the unit sit for 30 sec. to return to the original display.
- This unit can be programmed so that it will default to one of three temperatures if the remote controller is removed [140 °F (60 °C), 130 °F (55 °C), 120 °F (50 °C)]. To change the default temperature, adjust the dip switches as described below. The default temperature is 120 °F (50 °C).
1. Disconnect electrical power to the water heater.
  2. Remove the front cover of the water heater (4 screws).
  3. Disconnect the remote controller. Adjust the dip switches as illustrated below.
  4. Replace the front cover of the water heater (4 screws).
  5. Reconnect electrical power to the water heater.

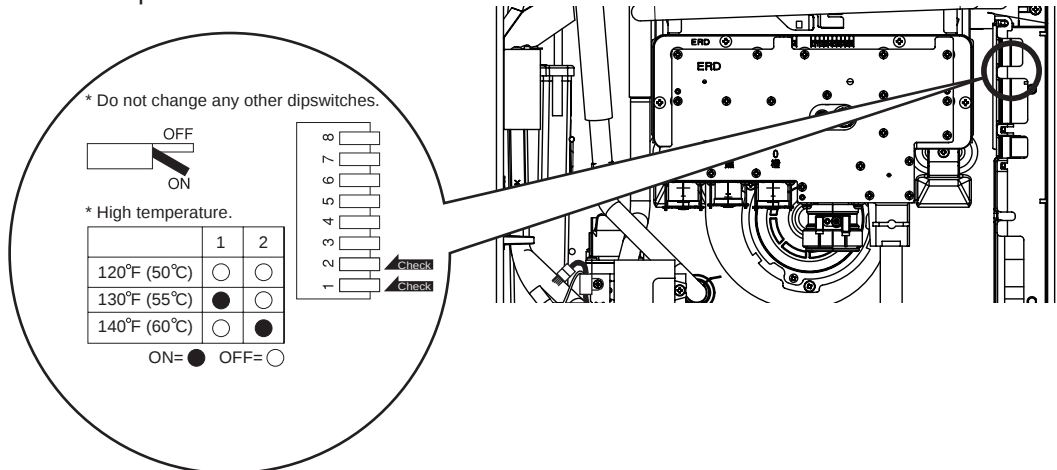

## DANGER

- When changing the temperature, make sure to confirm with the customer that the temperature of the hot water will be very high and that there is a risk of scalding.
- Hot water heater temperatures over 125 °F (52 °C) can cause severe burns instantly or death from scalding.


## Connecting Remote Controller Cord to Unit

- Keep the remote controller cord away from the freeze prevention heaters in the unit.
- Tie the redundant cord outside the water heater. Do not put the extra length inside the equipment.
- The remote controller cord can be extended up to 300' (90m) with 18AWG wire.
- Use a Y type terminal with a resin sleeve. (Without the sleeve, the copper wire may corrode and cause problems).
- Be sure to hand tighten when screwing to the terminal block. Power tools may cause damage to the terminal block.

### Remote controller cord

- For extensions, a 26' (8m) cord can be purchased (Part # RC-CORD26) or use 18AWG wire.
- Install according to the National Electrical Code and all applicable local codes.

1. Check to make sure that the remote controller cord has plenty of slack in order to reach the external connection terminal block.
2. Disconnect electrical power to the water heater.
3. Remove the single screw securing the terminal block cover and then remove the cover.
4. Pass the remote controller cord through the wiring throughway and connect the Y terminals at the end of the remote controller cord to the terminal block.
5. Replace the terminal block cover and install the screw previously removed in step 3.
6. Reconnect electrical power to the water heater.

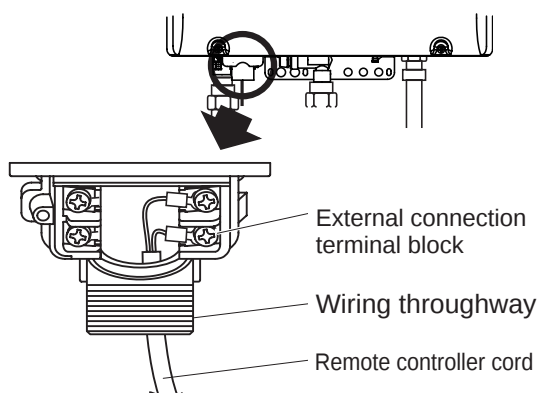

## Changing Other Features


### Adjusting the Temperature Display

Note: The setting must be done within the first 10 minutes of connecting electrical power to the water heater.

Table of Setting Items

| Item No. | Item                             | Choices (factory defaults shaded) |              |
|----------|----------------------------------|-----------------------------------|--------------|
| 12       | Celsius/Fahrenheit display mode. | °F (Fahrenheit)                   | °C (Celsius) |

## Remote Controller

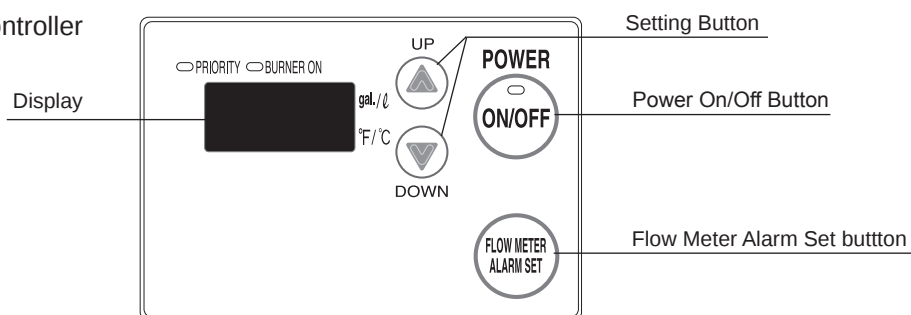

## Setting Procedure


1. Turn the water heater off by pressing the Power On/Off Button on the remote controller.
2. Disconnect, then reconnect electrical power to the water heater.
3. Press the Flow Meter Alarm Set Button and hold it in for 2 seconds or more.
4. Press the Flow Meter Alarm Set Button until the remote controller displays item number "12".
5. Press Setting Button "▲" for 5 seconds or more to change the display units to °F.
6. Press Setting Button "▼" for 5 seconds or more to change the display units to °C.
7. To confirm the setting, turn the water heater on by pressing the Power On/Off Button on the remote controller.

## Pump Wiring

\* This feature is not available when using the Quick Connect Multi System feature.


### Connecting the pump control wire

1. Leave enough slack so that the pump control wires will stay connected if the unit is removed from the wall.
2. Remove the front cover of the heater (4 screws).
3. Cut off the connector at the end of the pump control wires.
4. Wire the pump control wires through the wiring  
throughway and connect them to the wiring inside  
the pump (this will be the power supply for the pump,  
do not also connect 120VAC to the pump).  
If a large pump is being used (greater than 85W) use  
the voltage from these wires as the signal to close a  
normally open relay through which 120VAC will be  
supplied directly from a wall circuit to the pump.
5. Replace the front cover.

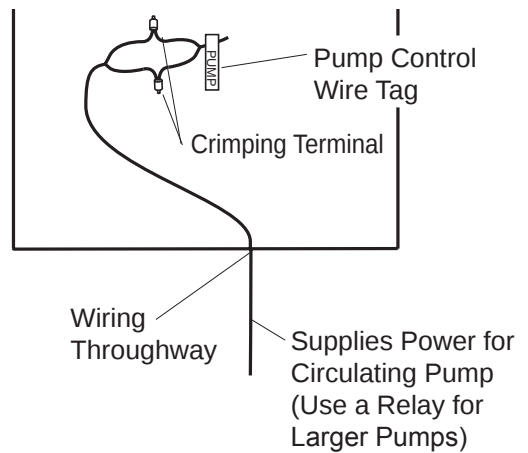

### Relay connection with larger pumps (>85 W)

1. Locate and prepare the pump control wires as described above.
2. Choose a suitable installation location for the relay where it will be protected from moisture.
3. Connect the pump control wires from the heater to the signal input on the relay.
4. Cut one of the electrical supply leads and wire it across the open terminals of the relay.
5. Secure all connections and replace the front cover of the heater.

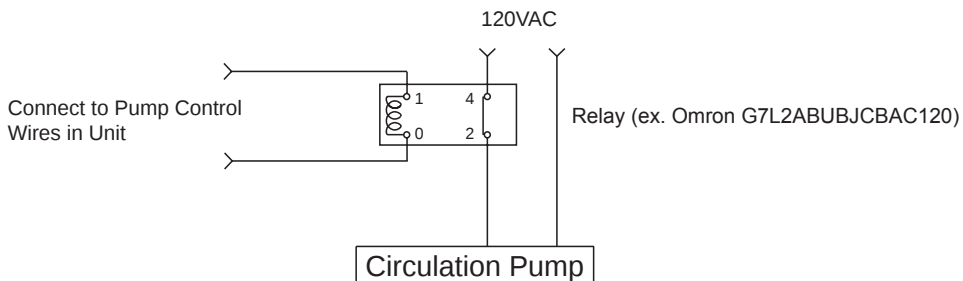


## Connecting Quick Connect Cord-2

For Quick Connect Multi System Installation use part #QC-2 only. (sold separately).

### Caution


The wire coloring on the Quick Connect Cord-2 will not be the same as the wire coloring of the connection plug inside the unit.

- \* The remote controller can be connected to either unit A or B. Do not connect a remote controller to both units.
- \* Disconnect the remote controller from either unit A or B prior to installing the Quick Connect Cord.

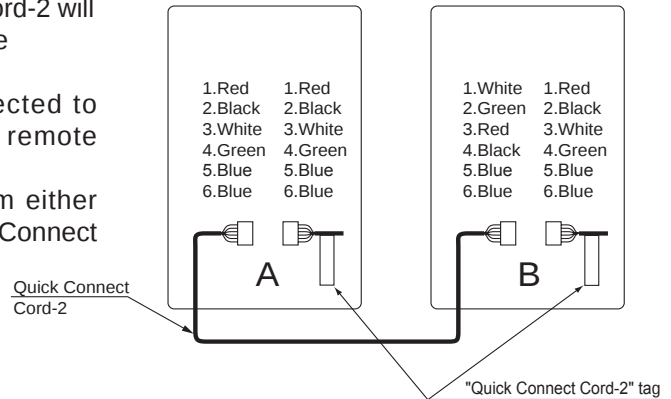

### Connecting the Quick Connect Cord to the two units.

1. Turn off the power.
2. Remove the front cover of the heater (4 screws).
3. Pass the Quick Connect Cord through the wiring throughway and into the unit.
4. Plug the connector on the Quick Connect Cord to the receptacle inside the unit.
5. Attach the ground wire of the Quick Connect Cord to the terminal block fixing plate.  
(If the ground wire is not attached, electrical noise may cause problems).
6. Secure the Quick Connect Cord with a clamp.
7. Replace the front cover.

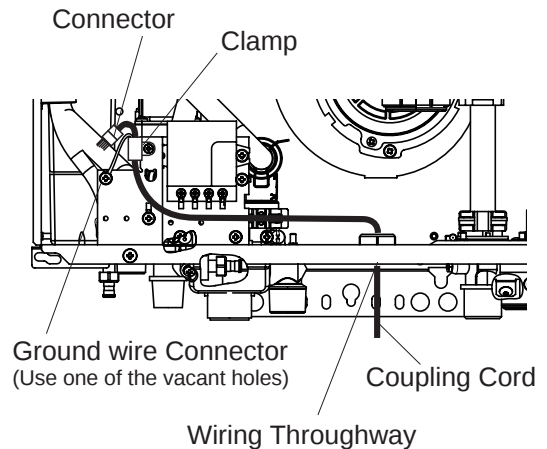

# 13. Maintenance

Periodically check the following to ensure proper operation of the water heater.

- The venting system must be examined periodically by a qualified service technician to check for any leaks or corrosion.
- The burner flame must be checked periodically for a proper blue color and consistency.
- If the flame does not appear normal, the burner may need to be cleaned.
- If the burner needs to be cleaned, it must be performed by a qualified service technician.
- Do not obstruct the flow of combustion and ventilation air.
- The pressure relief valve must be operated once a year to ensure that it is functioning properly and there is no obstruction. Turn the power off to the unit before opening the relief valve, and make sure that water draining out of the valve will not cause any damage.
- If the relief valve discharges periodically, it may be due to thermal expansion in a closed water system. Contact the water supplier or a local plumbing inspector on how to correct this situation. Do not plug the relief valve.
- See Operation Manual for further maintenance.

**Warning:** There is a scald potential if the output temperature is set too high.

Should overheating occur, or the gas supply fail to shut off, turn off the manual gas control valve to the appliance.

Do not use this appliance if any part has been under water. Immediately call a qualified service technician to inspect the appliance and to replace any part of the control system and any gas control which has been under water.

Periodically check and clean the filter inside the cold water inlet of the unit.

# 14. Trial Operation

The installer should test operate the unit, explain to the customer how to use the unit, and give the owner this manual before leaving the installation.

- Preparation ..... (1) Open a hot water fixture to confirm that water is available, and then close the fixture.  
(2) Open the gas supply valve.  
(3) Turn on the power supply. Using the remote controller, turn on the Power On/Off button (the Operation lamp will turn on).


- (1) Open a hot water fixture and confirm that the Burner On lamp comes on, and that hot water is being produced. (If necessary, repeat until the air in the gas piping is bled out).
  - \* White smoke may be noticed from the exhaust vent during cold weather. However, this is not a malfunction of the unit.
  - \* If an "11" error code appears on the remote controller, turn the unit off and then back on again, and then open a hot water fixture again.
- (2) Change the temperature setting on the remote controller and check that the water temperature changes.

- If the water heater does not operate normally, refer to "Troubleshooting" in the Operation Manual.
- \* After the trial operation, clean the filter in the cold water inlet.

<If installed with a quick connect multi-system>

- Turn the system power ON with the remote controller.
- Slowly open a hot water fixture and check that the units ignite sequentially. Check to see that the hot water temperature is the same as the temperature displayed on the remote controller (\*1)

\* If both units do not ignite, switch which unit will ignite first by pressing the Max. or Min. Manifold Pressure Set Button on the circuit board. (\*2)



\* If an 11 or F11 error code flashes on the remote controller, hit the Power Button on the remote controller off and on 2 -3 times.

\* If (\*1) and (\*2) cannot be done, the Quick Connect Cord may not be properly connected. Check that the cord is properly connected.



## CAUTION

### Handling after trial operation

- If the unit will not be used immediately, close off all gas and water shutoff valves, drain all of the water out of the unit and the plumbing system to prevent the unit and system from freezing, and bleed the gas out of the gas line.  
Freezing is not covered by the warranty.



## WARNING

A fire or explosion may result if these instructions are not followed, which may cause loss of life, personal injury or property damage.

### Lighting Instructions

This water heater does not have a pilot. It is equipped with an ignition device that automatically lights the burner.

Do not try to light the burner by hand.


1. Read the safety information in the installation manual or on the front of the water heater.
2. Turn off all electrical power to the unit.
3. Do not attempt to light the burner by hand.
4. Turn the gas control manual valve (external to the unit) clockwise to the off position.
5. Wait five minutes to clear out any gas. If the smell of gas remains, stop, and follow the instructions on page 3 of Owner's Guide.
6. Turn the gas control manual valve counterclockwise to the on position.
7. Turn on electric power to the unit.
8. The unit will now operate whenever hot water is called for. If the unit will not operate, follow the shutdown instructions and call a service technician.

### Shutdown Instructions

1. Stop any water demand.
2. Turn off electric power.
3. Turn the gas control manual valve clockwise to the off position.


Should overheating occur, or the gas supply fail to shut off, turn off the manual control valve to the appliance.

# 15. Dimensions

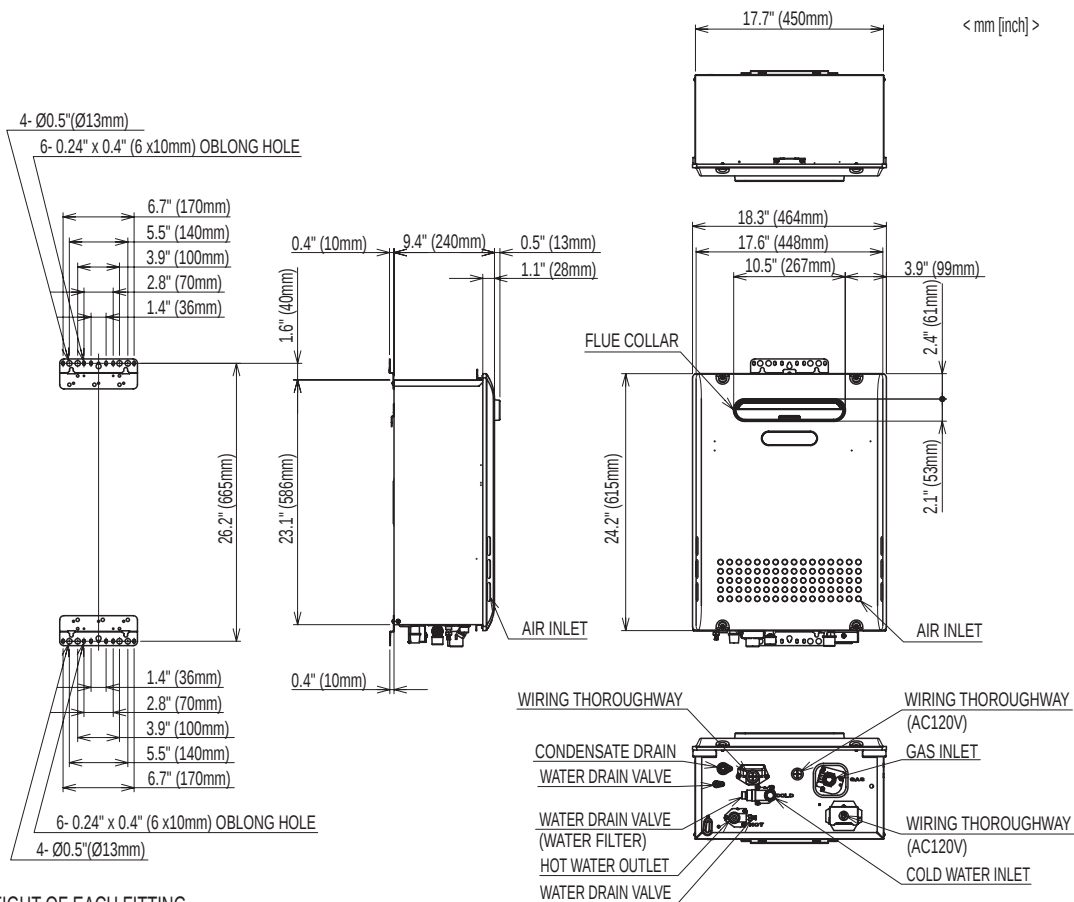

HEIGHT OF EACH FITTING  
FROM BOTTOM OF CASE

|                  |             |
|------------------|-------------|
| CONDENSATE DRAIN | 0.8" (20mm) |
| HOT WATER OUTLET | 1.8" (45mm) |
| COLD WATER INLET | 1.9" (49mm) |
| GAS INLET        | 2.2" (56mm) |

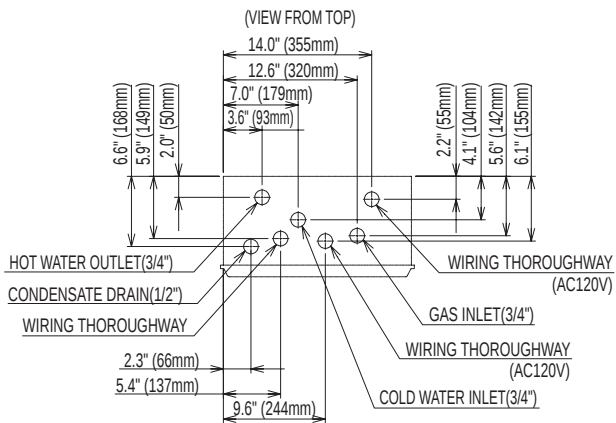

## Remote Controller RC-7651M

# Installation Guide

### For Installers:

Read this installation guide carefully before carrying out installation.


NORITZ AMERICA CORPORATION

### Note

Do not connect power to the water heater before the remote controller has been properly installed.  
Recommended installation location of the remote controller is in a bathroom.

### Included Parts List

| Part Name                     | Quantity |
|-------------------------------|----------|
| Remote Controller             | 1        |
| Wall Packing                  | 1        |
| Phillips Roundhead Wood Screw | 2        |
| Wall Anchor                   | 2        |

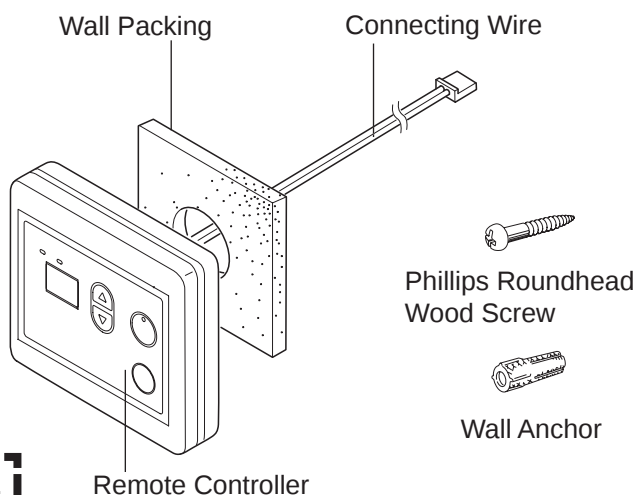

Do not disassemble the remote controller.

### Notes on the Installation Location

- The remote should be installed in an easily accessible location.
- Avoid installing in a place where water or steam can come into contact with the controller.
- Avoid locations where special chemical agents (e.g., benzene, fatty and oily detergents) are used.
- Avoid outdoor installation, or installation in an indoor location where it will be exposed to direct sunlight.

### Connection of Remote Controller Cord


White Connector → To Remote controller

Y-shaped terminals (two-core) → To Water heater


- \* Confirm the connection with the labels at both ends of the remote controller cord.
- A 26' (8m) cord can be purchased separately (Part # RC-CORD26).
- The remote controller cord can be extended up to 300 ft. (90m) by splicing the cord and using 18 gauge wire to extend the cord to the appropriate length.

## Installation

1. Apply Wall Packing to the rear side of the remote controller.
2. Connect the remote controller wires to the separate remote controller cord.

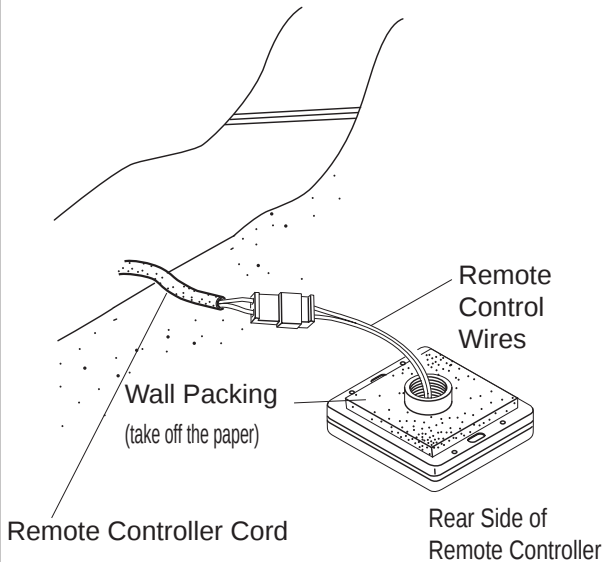


3. Remove the cover of the remote control, mark the location of the screw holes, and drill holes for the wall anchors.
4. Insert the wall anchors, screw the remote control to the wall and replace the cover.

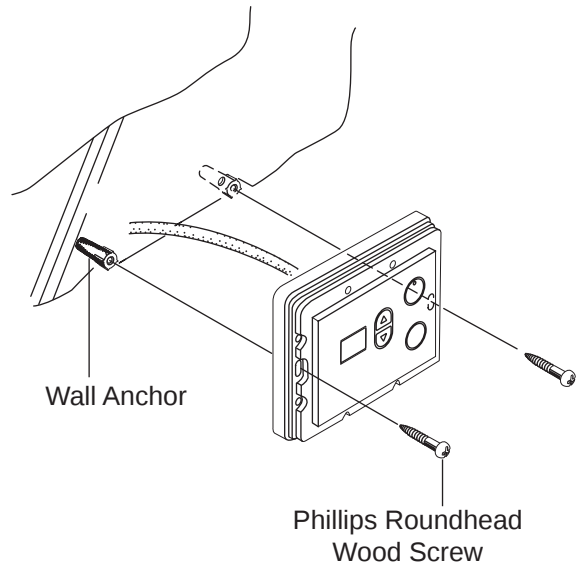


## Installing the Remote Controller Outdoor Junction Box

1. Insert the remote controller wires through the wall pipe and secure the wall pipe to the remote controller. Locate the remote controller wall packing, slide it over the pipe and wires, and apply it to the rear side of the remote.

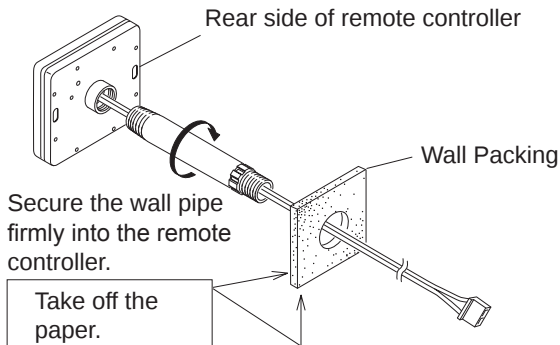

5. Slide the box nut over the remote controller wires and screw it onto the wall pipe.

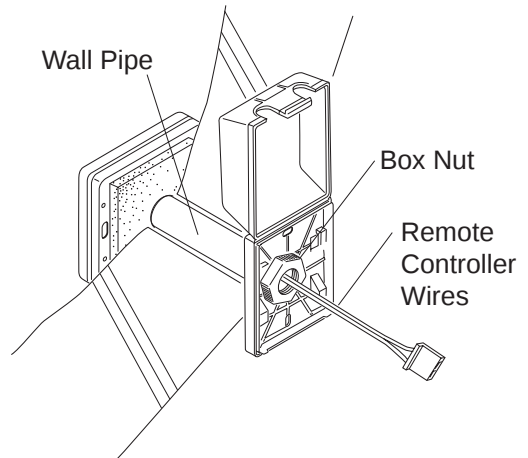


2. Drill a  $\varnothing 1\text{-}1/4$ " hole in the wall where the remote controller will be installed.


\* Do not install the remote controller in a location that is exposed to moisture, direct sunlight, or chemical agents. These can damage the remote controller.

3. Insert the wall pipe containing the remote controller wires through the hole.

4. Slide the junction box packing and the junction box over the remote controller wires and wall pipe protruding from the outside wall.

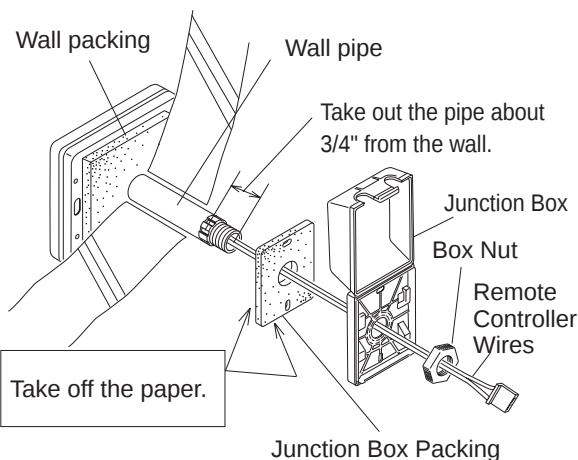

6. Connect the remote controller wires to the separate remote controller cord inside the box. Wind the excess remote controller wire on the provided hooks as illustrated below.

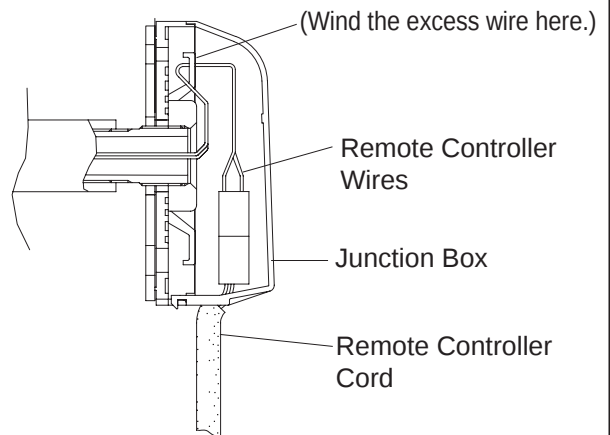

Tie the redundant length of the remote controller cord outside the junction box.

7. Close the junction box.