

► Code Number

3771623

► Flush Cycle

1.6 gpf/6.0Lpf

► Specifications

Quiet, Concealed, Rough Brass Closet Flushometer for either left or right hand supply with the following features:

- Chrome Plated Exposed Flushometer Parts
- Exposed Parts Chrome Plated
- Vacuum Breaker with Flush Connection
- Low Consumption flush accuracy
- User friendly three (3) second Flush Delay
- OPTIMA® EL-1500 Self-Adaptive Infrared Sensor with Indicator Light
- Adjustable Tailpiece
- Spud Coupling and Flanges for 1½" Exposed Top Spud
- High Copper, Low Zinc Brass Castings for Dezincification Resistance
- 13" x 17" EASY ACCESS® Wall Box with Stainless Steel Access Panel and Vandal Resistant Screws
- 1" I.P.S. Wheel Handle Bak-Chek® Angle Stop
- Courtesy Flush® Override Button
- High Chloramine Resistant PERMEX® Synthetic Rubber Diaphragm with Linear Filtered Bypass and Vortex Cleansing Action™
- Diaphragm, Stop Seat and Vacuum Breaker to be molded from PERMEX® rubber compound for Chloramine resistance

Valve Body, Cover, Tailpiece and Control Stop shall be in conformance with ASTM Alloy Classification for Semi-Red Brass. Valve shall be in compliance with the applicable sections of ASSE 1037 and ANSI/ASME 112.19.2.

► Wall Box Specifications

- EASY ACCESS® Wall Box Assembly — Part #EL-192-A
- Frame: 13" x 17" x 4" (330 mm x 432 mm x 102 mm) #16 Gauge Steel
- Cover (Access Panel): 14½" x 18½" (368 mm x 470 mm) #15 Gauge #304 Stainless Steel, #4 Finish
- Screws: (6) #8-32 x ¾" Drilled Spanner Head — Spanner Bit Provided

► Variations

2-10 3/4 LDIM


► Control Circuit

- Solid State
- 3 Second Flush Delay
- 24 VAC Input
- 24 VAC Output

16 Second Arming Delay

► L Dimension

Specify the "L" Dimension for the proper length of the Handle Assembly and Flush Connection. The "L" Dimension is equal to the Wall Thickness (to the nearest whole inch) plus 2¾" (70 mm).

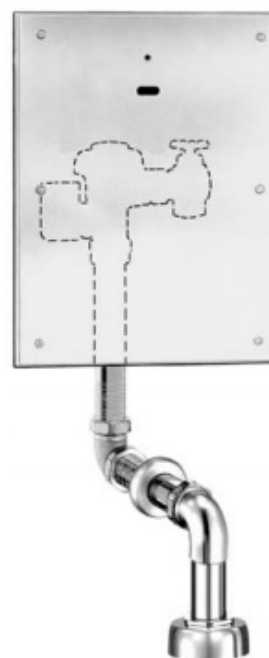

► Economical

Automatic operation provides water usage savings over other flushing devices. Reduces maintenance and operation costs.

► Practical

Solid state electronic circuitry assures years of dependable, trouble-free operation. The operational components of the Flushometer are identical to a handle activated Sloan® Flushometer, proven by over 100 years of experience.

► Automatic Operation

Sloan OPTIMA® equipped Flushometers provide the ultimate in sanitary protection and automatic operation. There are no handles to trip or buttons to push. The Flushometer operates by means of an infrared sensor that adapts to its surrounding. Once the user enters the sensor's effective range and then steps away, the Flushometer Solenoid initiates the flushing cycle to flush the fixture.

► Hygienic

User makes no physical contact with the Flushometer surface except to initiate the Override Button when required. Helps control the spread of infectious diseases.

► Made in the U.S.A.

► Compliance & Certifications



**Made In The
USA**

This space for Architect/Engineer Approval

► Solenoid Operator

24 VAC, 50/60 Hz

► Transformers

Sloan Part #EL-154 120 VAC, 50/60 Hz Primary 24 VAC, 50/60 Hz
Secondary Class II, UL Listed, 50 VA.

Sloan Part #EL-342 240 VAC, 50/60 Hz Primary 24 VAC, 50/60 Hz
Secondary Class II, UL Listed, 50 VA.

► Accessories (Sold Separately)

EL-154 120 VAC/24 VAC, 50/60 Hz (50 VA) - Box Mount (will operate
up to 3 faucets)

Transformer (240 VAC/24 VAC, 50 VA) EL-342

See Accessories Section and OPTIMA® Accessories Section of the
Sloan catalog for details on these and other OPTIMA® Flushometer
variations.

► Sensor Range

Nominal 22" - 42" (559 mm - 1067 mm) Self-adaptive Window: ± 10"
(254 mm)

► ELECTRICAL BOX INSTALLATION


SENSOR LOCATION AND POSITIONING IS CRITICAL

Adjust the Mounting Bracket so that the Sensor sits flush against the
Cover Plate.

Refer to the instructions packaged with the Flushometer for
additional installation information.

Failure to properly position the electrical boxes to the plumbing
rough-in will result in improper installation and impair product
performance. All tradesmen (plumbers, electricians, tile setters, etc.)
involved with the installation of this product must coordinate their
work to assure proper product installation. Installation Template
furnished with Flushometer.

► ROUGH-IN

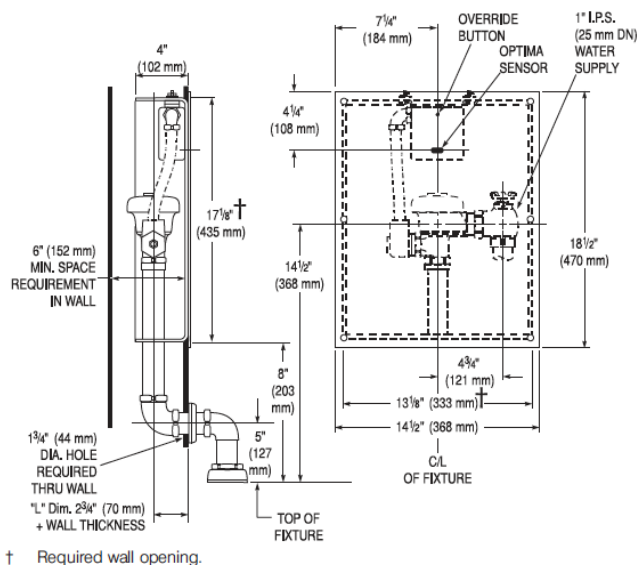

† Required Wall Opening

► OPERATION



1. A continuous, invisible light beam is emitted from the
OPTIMA Sensor.



2. As the user enters the beam's effective range (22" to 42")
the beam is reflected into the OPTIMA Scanner Window and
transformed into a low voltage electrical circuit. Once
activated, the Output Circuit continues in a "hold" mode for
as long as the user remains within the effective range of the
Sensor.



3. When the user steps away from the OPTIMA Sensor, the
circuit waits 3 seconds (to prevent false flushing) then initiates
an electrical "onetime" signal that operates the Solenoid. This
initiates the flushing cycle to flush the fixture. The Circuit then
automatically resets and is ready for the next user.


► WIRING DIAGRAM

One Transformer serves up to ten (10) OPTIMA Closet/ Urinal
Flushometers. Specify number of transformers required accordingly.

ELECTRICAL BOX INSTALLATION

SENSOR LOCATION AND POSITIONING IS CRITICAL

Failure to properly position the electrical boxes to the plumbing
rough-in will result in improper installation and impair product
performance. All tradesmen (plumbers, electricians, tile setters, etc.)
involved with the installation of this product must coordinate their
work to assure proper product installation.

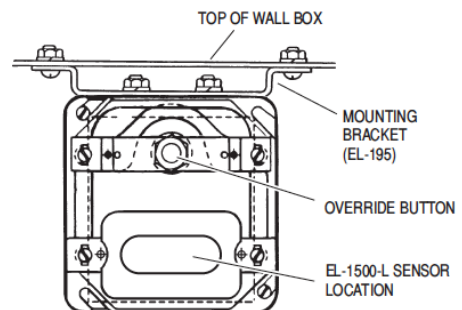

Adjust the Mounting Bracket so that the Sensor sits flush against the cover plate.

Refer to the instructions packaged with the Flushometer for additional
installation information.