


APPROVAL DRAWING

- ☐ APPROVED AS SHOWN
☐ REVISION REQUIRED AS NOTED
☐ RESUBMIT WITH REVISIONS NOTED

UTILITY: _____
BY: _____
DATE: _____

NOTES:

- 1) FINISH: ANSI 61 GRAY
- 2) CABINET: 16 GA GALV. STEEL, TYPE 3R RAINLIGHT
- 3) 200 AMP CONTINUOUS, 10,000–200,000 AMP IC, 600 VAC, 1 PHASE, 3 WIRE
- 4) USE MSR5TK FOR 5TH TERMINAL FIELD INSTALLATION.
- 5) USE MSRHBK FOR HORN BYPASS FIELD INSTALLATION.
- 6) TEMPORARY CARDBOARD METER OPENING COVER PROVIDED.
- 7) ALL DIMENSIONS ARE IN INCHES.

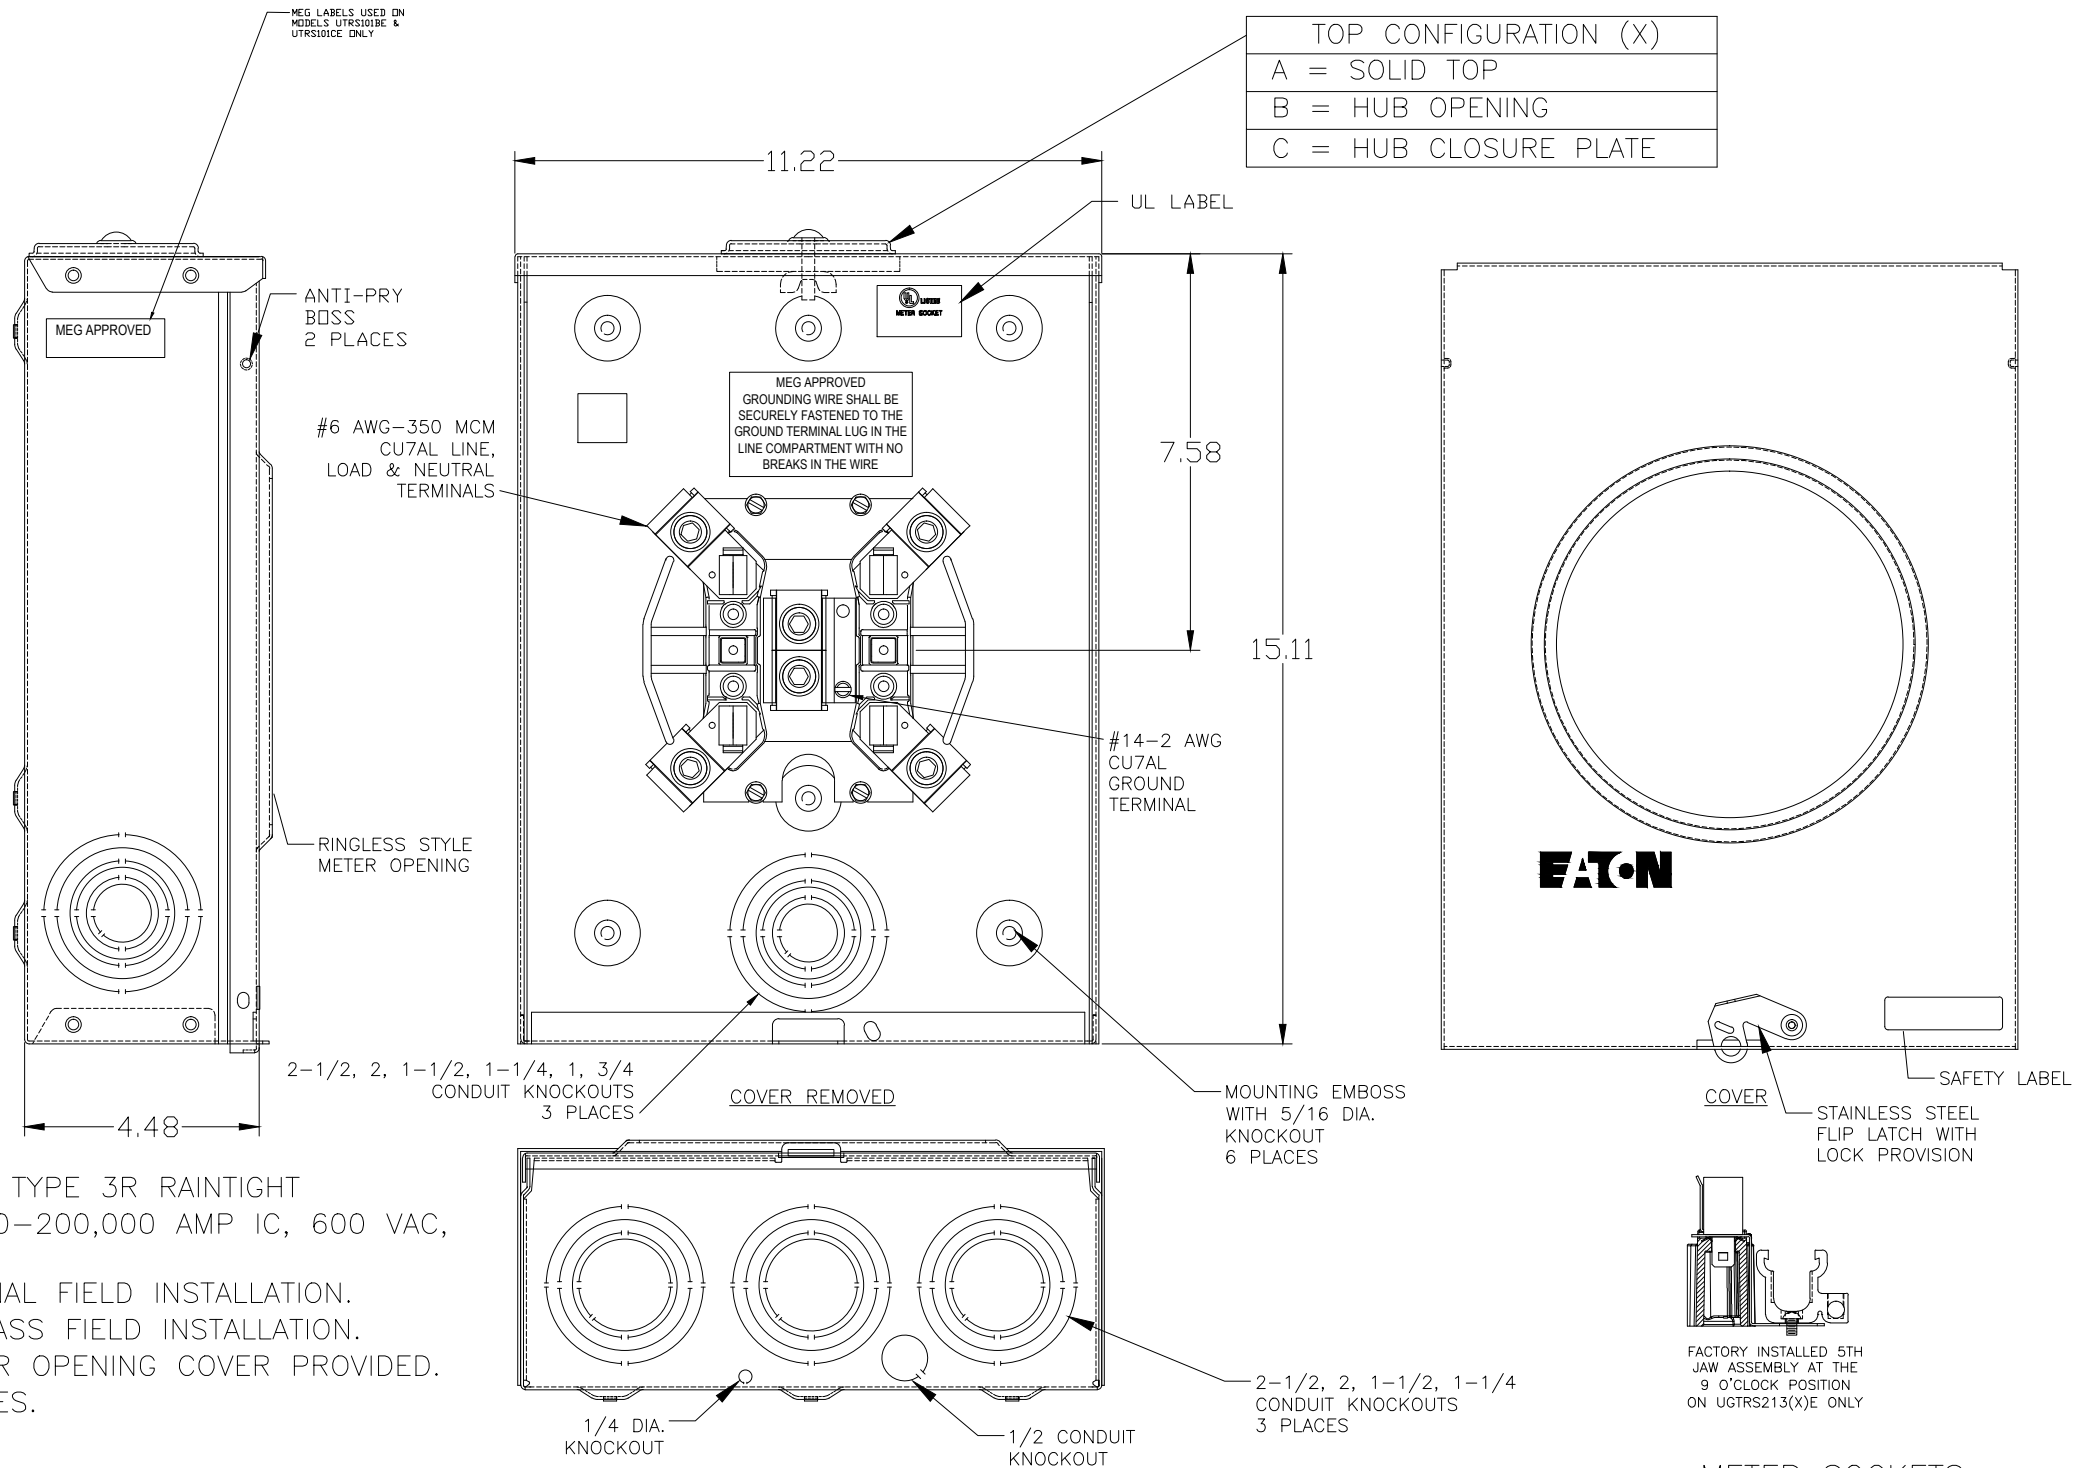

METER SOCKETS
UTRS213(X)E, UGTRS213(X)E
200AMP, 1Ø OH/UG
RINGLESS STYLE

FILE DESCRIPTION METER SOCKETS UTRS213(X)E, UGTRS213(X)E 200AMP, 1Ø OH/UG RINGLESS STYLE		DATE (YYYYMMDD) 2016/5/12
THE INFORMATION ON THIS DRAWING IS DISCLOSED IN CONFIDENCE AND IS NOT TO BE REPRODUCED, USED OR DISCLOSED, EXCEPT FOR THE PURPOSE WHICH FURNISHED.		REVISION 004
DRAWING NUMBER 41-3493		SCALE N/A
SHEET 1 OF 1		DESIGNER S. SHIRKE