



COPPER H-TAP PRESSURE CABLE CONNECTOR CAT. NO. CHT750350-2



- **CABLE RANGE:** (kcmils)



Main: 750-500 STR Cu
500 Flex

Branch: 750-500 STR Cu
500-350 Flex

- **INSTALLING TOOL:** TBM15 with 15620CHF Yellow Die

1. Strip insulation from cables to allow for clearance of taps. DO NOT nick the strands.
2. Insert the cable(s) into the corresponding groove(s). MAIN and BRANCH.
3. Secure the cables at either side of the connector by using the TY-RAP® cable ties enclosed.
4. Install the proper die in the crimping tool (refer to label). Note the matching "color code" on die and connector.
5. Locate the connector properly in the dies and crimp.

⚠ WARNING ⚠
DO NOT CRIMP ON HOT
ENERGIZED WIRES.

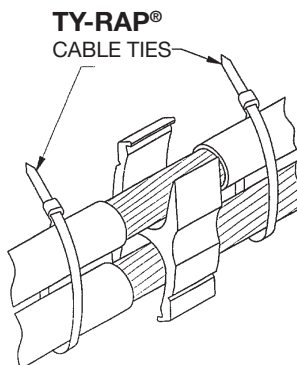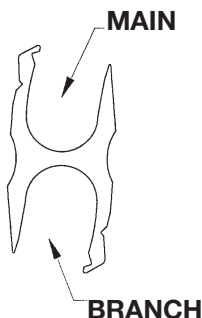

WARRANTY: Thomas & Betts sells this product with the understanding that the user will perform all necessary tests to determine the suitability of this product for the user's intended application. Thomas & Betts warrants that this product will be free from defects in materials and workmanship for a period of two (2) years following the date of purchase. Upon prompt notification of any warranted defect, Thomas & Betts will, at its option, repair or replace the defective product or refund the purchase price. Proof of purchase is required. Misuse or unauthorized modification of the product voids all warranties.

Limitations and Exclusions: THE ABOVE WARRANTY IS THE SOLE WARRANTY CONCERNING THIS PRODUCT, AND IS IN LIEU OF ALL OTHER WARRANTIES EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO ANY IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE, WHICH ARE SPECIFICALLY DISCLAIMED. LIABILITY FOR BREACH OF THE ABOVE WARRANTY IS LIMITED TO COST OF REPAIR OR REPLACEMENT OF THE PRODUCT, AND UNDER NO CIRCUMSTANCES WILL THOMAS & BETTS BE LIABLE FOR ANY INDIRECT, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES.

Thomas & Betts Corporation
Memphis, TN 38125
In Canada, Thomas & Betts Ltd., Iberville, P.Q.
Website: www.tnb.com